

20030228071

REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

AD-A277 689

It is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this burden to Washington Headquarters Services, Directorate for Information Operations and Reports, 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302, attention: OMB Control Number Management.

1. REPORT DATE

08/00/00

3. REPORT TYPE AND DATES COVERED

(2)

4. TITLE AND SUBTITLE

ROCKY MOUNTAIN ARSENAL, NORTHWEST BOUNDARY CONTAINMENT/TREATMENT SYSTEM,
OPERATIONAL ASSESSMENT REPORT, FY89, FINAL

5. FUNDING NUMBERS

6. AUTHOR(S)

7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES)

ROCKY MOUNTAIN ARSENAL (CO.). PMRMA

8. PERFORMING ORGANIZATION
REPORT NUMBER

91270R01

9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)

ROCKY MOUNTAIN ARSENAL (CO.). PMRMA

10. SPONSORING/MONITORING
AGENCY REPORT NUMBER

11. SUPPLEMENTARY NOTES

12a. DISTRIBUTION/AVAILABILITY STATEMENT

APPROVED FOR PUBLIC RELEASE; DISTRIBUTION IS UNLIMITED

12b. DISTRIBUTION CODE

13. ABSTRACT (Maximum 200 words)

THIS STUDY IS THE FOURTH OPERATIONAL ASSESSMENT OF THE NORTHWEST BOUNDARY CONTAINMENT/TREATMENT SYSTEM AT THE RMA.

THE PURPOSE OF THIS REPORT IS TO DOCUMENT THE SYSTEM OPERATING PARAMETERS AND PERFORMANCE DURING FY89, AND TO IDENTIFY AND DOCUMENT ANY SYSTEM IMPROVEMENT AND FACILITY ALTERATIONS IMPLEMENTED DURING FY89.

DTIC
ELECTE
APR 05 1994
S F D

DTIC QUALITY INSPECTED 3

14. SUBJECT TERMS

GROUNDWATER, WELL, CHEMICAL

15. NUMBER OF PAGES

16. PRICE CODE

17. SECURITY CLASSIFICATION
OF REPORT

UNCLASSIFIED

18. SECURITY CLASSIFICATION
OF THIS PAGE19. SECURITY CLASSIFICATION
OF ABSTRACT

20. LIMITATION OF ABSTRACT

NSN 7540-01-280-5500

Standard Form 298 (Rev. 2-89)
Prescribed by ANSI Std Z39-18
298-102

91270R01

ROCKY MOUNTAIN ARSENAL
NORTHWEST BOUNDARY CONTAINMENT/TREATMENT SYSTEM
OPERATIONAL ASSESSMENT REPORT

FY89

FINAL REPORT

94-10107

BY

TECHNICAL OPERATIONS DIVISION
PROGRAM MANAGER, ROCKY MOUNTAIN ARSENAL
COMMERCE CITY, COLORADO 80022-2180

94 4

4 040

AUGUST 1990

Rocky Mountain Arsenal
Information Center
Commerce City, Colorado

Accession For	
NTIS	CRA&I
DTIC	TAB
Unauthorized	
Justification	
By _____	
Distribution / _____	
Availability Codes	
Dist	Aval and/or Special
A-1	

66010

PREFACE

This study was conducted as part of a cooperative effort by personnel from the Technical Operations Division (TOD) of the Program Manager for Rocky Mountain Arsenal (PMRMA) and the U.S. Army Engineer Waterways Experiment Station (WES). Funding for participation by WES was provided by the PMRMA via Intra-Army Order No. 0090. Project management was provided by Messrs. David W. Strang, TOD, Norman R. Francine, WES Environmental Laboratory (EL) and James H. May, WES Geotechnical Laboratory (GL).

This study is the fourth operational assessment of the Northwest Boundary Containment/Treatment System at Rocky Mountain Arsenal (RMA). The contributing authors to this report were Messrs. Jack H. Dildine, Douglas W. Thompson, Norman R. Francine (WES-EL), Richard J. Lutton, and John B. Palmerton (WES-GL). The study and report were authorized by the Program Manager for Rocky Mountain Arsenal.

The authors acknowledge the support and assistance of the following people and organizations during this study: Ms. Dianna Pantle and Ms. Tina Nowlin, D. P. Associates, and Ms. Tommie Ann Gard of A.S.K., Associates.

CONTENTS

	<u>Page</u>
PREFACE	1
PART I: INTRODUCTION	5
Background	5
Report Objective	7
Approach	7
PART II: PLANT OPERATIONS MONITORING	8
PART III: SYSTEM OPERATIONS	11
Operations Summary	11
System Flow Quantities	11
System Influent and Effluent Water Quality	14
Contaminant Mass Removal	31
Carbon Usage	32
Contaminant Concentrations in Dewatering Wells	32
PART IV: GROUND-WATER FLOW EVALUATION	45
Geology and Hydrogeology	45
Ground-Water Hydrology	49
Recharge Function	56
PART V: CONCLUSIONS	57
REFERENCES	58
APPENDIX A: FLOW DATA	A1
APPENDIX B: TREATMENT PLANT WATER QUALITY DATA STATISTICAL SUMMARY AND GC/MS ANALYSIS	B1
APPENDIX C: DEWATERING WELL DATA	C1
APPENDIX D: NORTHWEST BOUNDARY SYSTEM DOWNTIME	D1

LIST OF TABLES

No.		Page
1	Chemical Analysis of Treatment Plant Samples	9
2	Northwest Boundary System Treatment Plant Downtime for FY89	11
3	FY89 System Flow Quantities	14
4	Maximum Operating Limits for Northwest Boundary Systems	16
5	Northwest Boundary System Contaminant Removal for FY89	32

LIST OF FIGURES

No.		Page
1	Northwest Boundary Containment/Treatment System layout map	6
2	Adsorber 1 flow rate during FY89	12
3	Adsorber 2 flow rate during FY89	12
4	Adsorber 3 flow rate during FY89	13
5	Effluent flow rate during FY89	13
6	FY89 Aldrin concentration	17
7	FY89 Chloride Concentration	18
8	FY89 Chloroform (CHCL ₃) concentrations	20
9	FY89 Diisopropylmethylphosphonate (DIMP) concentrations	21
10	FY89 Dieldrin concentrations	22
11	FY89 Endrin concentrations	23
12	FY89 Fluoride concentrations	24
13	FY89 Isodrin concentrations	26
14	FY89 Parathion concentrations	27
15	FY89 Sulfate (SO ₄) concentrations	28
16	FY89 Tetrachloroethylene (TCLEE) concentrations	29
17	FY89 Trichloroethylene (TRCLE) concentrations	30
18	FY89 Aldrin concentrations in NWBS dewatering wells	33
19	FY89 Chloride concentrations in NWBS dewatering wells	35
20	FY89 Dicyclopentadiene (DCPD) concentration in NWBS dewatering wells	36
21	FY89 Diisopropylmethylphosphonate (DIMP) concentrations in NWBS dewatering wells	38
22	FY89 Dieldrin concentrations in NWBS dewatering wells	39
23	FY89 Endrin concentrations in NWBS dewatering wells	40
24	FY89 Fluoride concentrations in NWBS dewatering wells	41
25	FY89 Isodrin concentrations in NWBS dewatering wells	43
26	FY89 Trichloroethylene (TRCLE) concentration in NWBS dewatering wells	44
27	Water-table configuration (ft) at start of FY 89	46
28	Water-table configuration (ft) at end of FY 89	47
29	Water-table difference (ft) between start and end of FY 89	48
30	Location of water-table profiles	50
31	Profile I for FY 89	51
32	Profile II for FY 89	52
33	Profile III for FY 89	53
34	Profile IV for FY 89	54
35	Comparison of ground-water levels	55

**CONVERSION FACTORS, U.S. CUSTOMARY TO METRIC (SI)
UNITS OF MEASUREMENT**

U.S. customary units of measurement used in this report can be converted to metric (SI) units as follows.

<u>Multiply</u>	<u>By</u>	<u>To Obtain</u>
acre	4046.873	square metres
cubic feet	0.02831685	cubic metres
feet	0.3048	metres
feet per mile (U.S. statute)	0.1893936	metres per kilometre
gallons (U.S. liquid)	3.785412	cubic decimetres
horsepower (550 foot-pounds (force) per second)	745.6999	watts
inches	2.54	centimetres
miles (U.S. statute)	1.609347	kilometres
pounds (mass) per cubic foot	16.01846	kilograms per cubic metre
square feet	0.09290304	square metres
square miles	2.589998	square kilometres

NORTHWEST BOUNDARY CONTAINMENT/TREATMENT SYSTEM
OPERATIONAL ASSESSMENT REPORT FY89

PART I: INTRODUCTION

Background



1. The Northwest Boundary Containment/Treatment System* Operational Assessment described herein has been prepared to document and evaluate the performance related to the boundary system operations. This report covers the system operating period of FY89.

2. Ground-water contamination problems have existed in the area of the Northwest boundary of Rocky Mountain Arsenal (RMA) since the mid 1950's, when investigations were conducted by the Army Corps of Engineers. In 1975, a ground-water surveillance program for RMA was established. This regional surveillance task included the monitoring of wells in the arsenal boundary areas. Since that time, several problem definition studies and design investigations have been conducted by RMA and the Corps of Engineers. Subsequently, a ground-water surveillance program was initiated in 1978 specifically for the Northwest boundary.

3. As a result of the ground-water investigations in 1980, several contaminants including DIMP, DBCP, chloride, endrin and dieldrin were detected in a narrow plume of ground water leaving RMA to the north and northwest. Additional studies by RMA and the Corps of Engineers lead to the design and construction of the Northwest Boundary Containment/Treatment System (NWBS) that was completed in October 1984 (Figure 1). This was the third boundary ground-water contamination control system constructed and operated at RMA.

4. This report incorporates by reference major system descriptions and previous operations described in the report entitled "Northwest Boundary Containment/Treatment System Baseline Conditions, System Startup and Operational Assessment Report for FY85/86" (PMRMA 1987). The reader is referred to the basic report for detailed information concerning a complete physical description of the system. The basic report is catalogued at the Rocky Mountain Arsenal Information Center (RIC) library and is document number 88054R01.

* Hereinafter referred to as Northwest Boundary System.

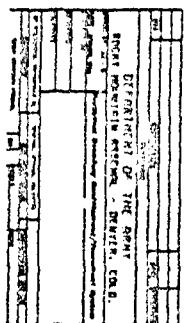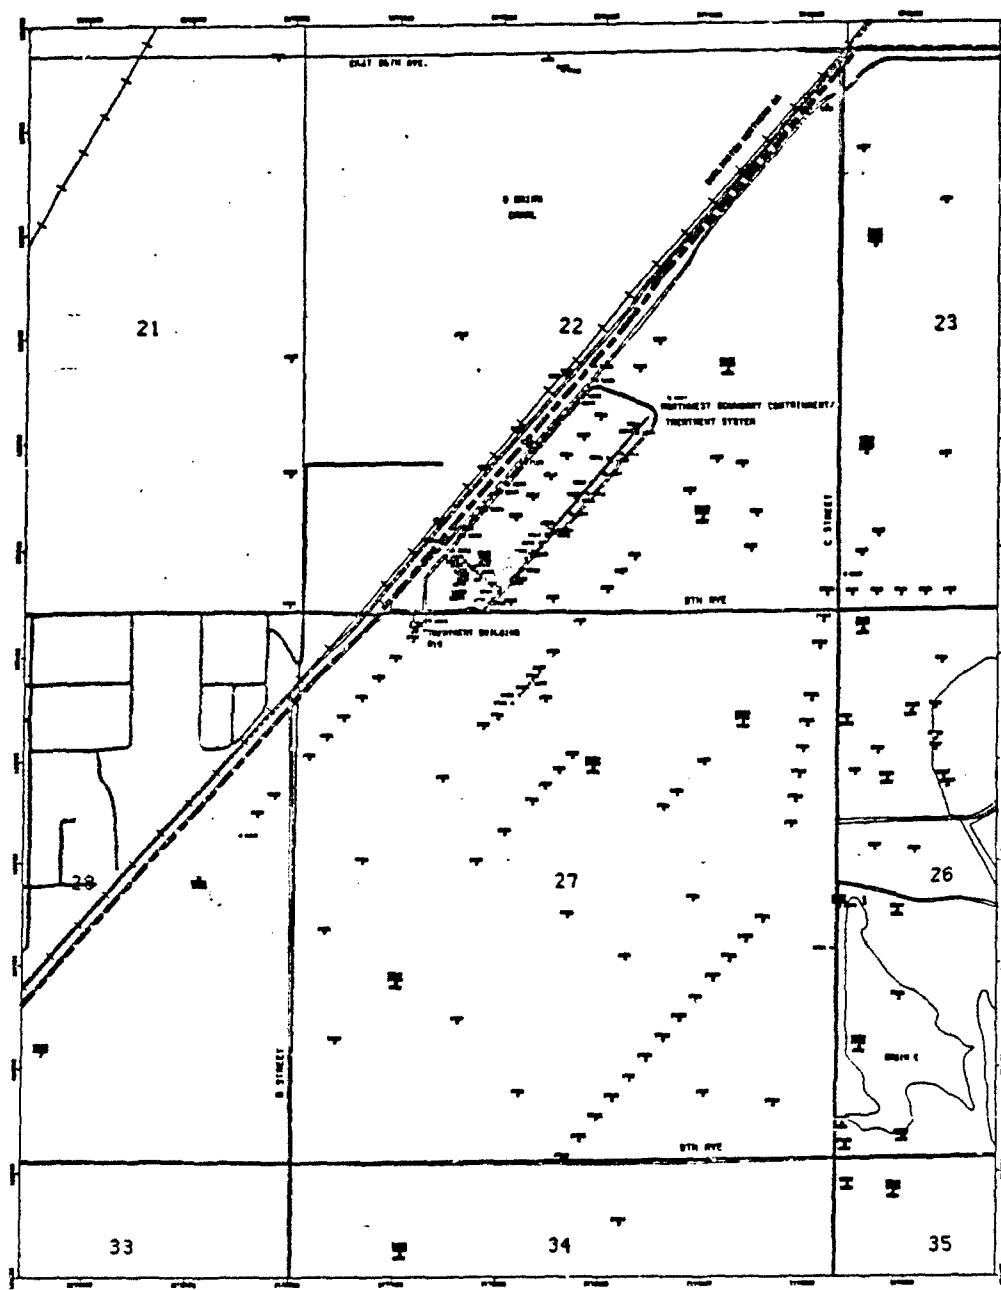

Report Objective

5. The objective of this report is to document the system operating parameters and performance during FY89, and, to identify and document any system improvements and facility alterations implemented during FY89.

Approach

6. The Technical Operations Division (TOD) at RMA provided the data base and general technical guidance. The U.S. Army Engineer Waterways Experiment Station (WES), Vicksburg, Mississippi, provided specialized environmental engineering assessments.

7. The study was conducted in three phases. Data were retrieved and organized by the TOD and RIC. The data bases were reviewed by WES for completeness prior to conducting various system performance evaluations. During the course of study, several in-progress reviews and coordination working sessions were held at the RMA, to facilitate exchange of information and to assure continuity and consistency in data interpretations and evaluations. Finally, the report was assembled from individual sections prepared by the various contributing authors.

PART II: PLANT OPERATIONS MONITORING

8. The treatment plant monitoring program continued in FY89. It included collection of data on flow rates through the system, and the quality of the water entering and leaving the plan.. The flow rates were recorded on a daily basis.

9. Samples were taken weekly from the interior of the adsorbers for process control. These data were used to determine when (if necessary) to change carbon within the adsorber. The qualities of the plant's influent and effluent waters were monitored by taking water samples on a weekly basis and analyzing them. Samples were also collected from the dewatering wells and analyzed. These samples were collected from ports located in the well pits.

10. All water samples were collected in previously cleaned, glass containers, sealed, and transported to the appropriate analytical laboratory at RMA or their contractor for analysis. The parameters for which the plant samples were analyzed for during FY89 are presented in Table 1. All analyses were performed using standard methods. The sample analysis and flow data were entered into the analytical data base by laboratory personnel, subjected to a quality control routine, validated, and placed into the PMRMA data base by the RIC. Data sets were prepared for use in developing tables and figures. Copies of the plant flow, analytical data and NWBS downtime for FY89 are contained in Appendices A, B, C, and D of this report.

Table 1
Chemical Analysis of Treatment Plant Samples

<u>Analyte</u>	<u>1st</u>	<u>2nd</u>	<u>3rd</u>	<u>4th</u>
<u>Organochlorine Pesticides</u>				
Aldrin	X	X	X	X
Endrin	X	X	X	X
Dieldrin	X	X	X	X
Isodrin	X	X	X	X
Hexachlorocyclopentadiene		X	X	
p,p'-DDE		X	X	
p,p'-DDT		X	X	
Chlordane		X	X	
<u>Volatile Organohalogens</u>				
Chlorobenzene		X	X	
Chloroform		X	X	
Carbon Tetrachloride		X	X	
Trichloroethylene (TCE)	X	X	X	X
Tetrachloroethylene		X	X	
1,1 Dichloroethylene		X	X	
1,1 Dichloroethane		X	X	
1,2 Dichloroethane		X	X	
1,1,1 Trichloroethane		X	X	
1,1,2 Trichloroethane		X	X	
Methylene Chloride		X	X	
1,2 Dichloroethylene		X	X	
<u>Organosulfur Compounds</u>				
P-Chlorophenylmethylsulfone (PCPMSO ₂)	X	X	X	X
P-Chlorophenylmethylsulfoxide (PCPMSO)	X	X	X	X
P-Chlorophenylmethylsulfide (PCPMS)	X	X	X	X
1,4-Dithiane	X	X	X	X
1,4-Oxathiane	X	X	X	X
Dimethyl disulfide (DMDS)		X	X	
Benzothiazole		X	X	
<u>NP-Pesticides</u>				
Vapona		X		
Supona		X		
Atrazine		X		
Malathion		X		
Parathion		X	X	

(Continued)

Table 1 (Concluded)

<u>Analyte</u>	<u>FY89 Quarters</u>			
	<u>1st</u>	<u>2nd</u>	<u>3rd</u>	<u>4th</u>
<u>DCPD/MIEK</u>				
Dicyclopentadiene	X	X	X	X
Methylisobutylketone		X	X	
Bicycloheptadiene			X	
<u>DIMP/DMMP</u>				
Diisopropylmethylphosphonate	X	X	X	X
Dimethylmethylphosphonate		X	X	
<u>DBCP</u>				
Dibromochloropropane	X	X	X	X
<u>Inorganics</u>				
Arsenic			X	X
Chloride	X	X	X	X
Fluoride	X	X	X	X
Sulfate			X	X
Alkalinity				
Calcium				
Cadmium				
Chromium				
Copper				
Cyanide				
Mercury				
Magnesium				
Potassium				
Sodium				
Combined (Nitrate/Nitrates)				
Lead				
Zinc				
<u>Volatile Aromatics</u>				
Toluene		X	X	
Benzene		X	X	
Xylene (o-, m-, p-)		X	X	
Ethylbenzene		X	X	
1,3 Dimethylbenzene		X	X	
<u>GC/MS Analysis</u>				
			X	

PART III: SYSTEM OPERATIONS

Operations Summary

11. A record of plant operations for the NWBS is maintained by RMA plant operating personnel with major events documented on a daily basis. The daily record contains information on the operations, maintenance activities, and repair of the treatment plant equipment and dewatering and recharge wells. The record also details other events such as plant downtime, equipment failure, and filter and carbon removal and replacement.

12. The performance of the Northwest Boundary System was very good during FY89 with minimal downtime being reported. The NWBS was never totally out of operation for more than 5.25 consecutive hours during the year. A summary of the downtime for each adsorber by quarter is presented in Table 2. Details on each downtime event are presented in appendix D. The majority of the downtime was associated with leaks and plugged lines. As indicated in Table 2, no downtime was reported for the third and fourth quarters of FY89. There were no major physical alterations to the NWBS during FY89.

Table 2
Northwest Boundary System Treatment Plant
Downtime for FY89

Adsorber	FY89 Quarter				Total
	1st(hrs)	2nd(hrs)	3rd(hrs)	4th(hrs)	
V101	0.0	13.4	0.0	0.0	13.4
V102	25.8	29.7	0.0	0.0	46.5
V103	0.0	23.5	0.0	0.0	23.5
Plant	5.5	0.0	0.0	0.0	5.5

System Flow Quantities

13. The volume of water processed by the NWBS is recorded on a daily basis. The flow data recorded for FY89 are presented in tables in Appendix A of this report. Graphs of weekly flow data for each adsorber and the effluent have been prepared and are presented in Figures 2 through 5. The treatment

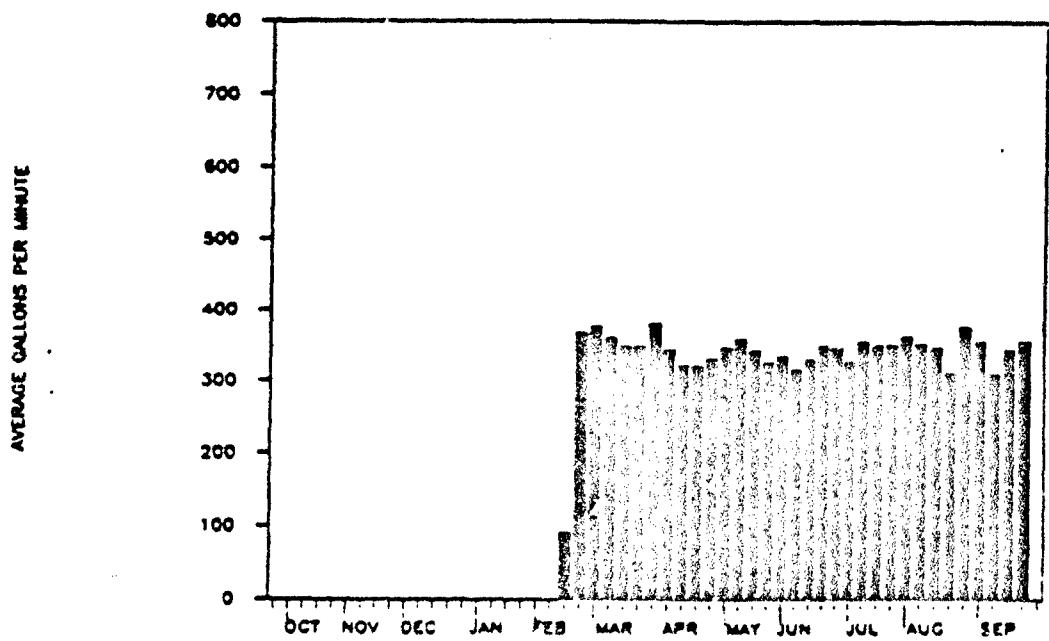


Figure 2. Adsorber 1 flow rate during FY89

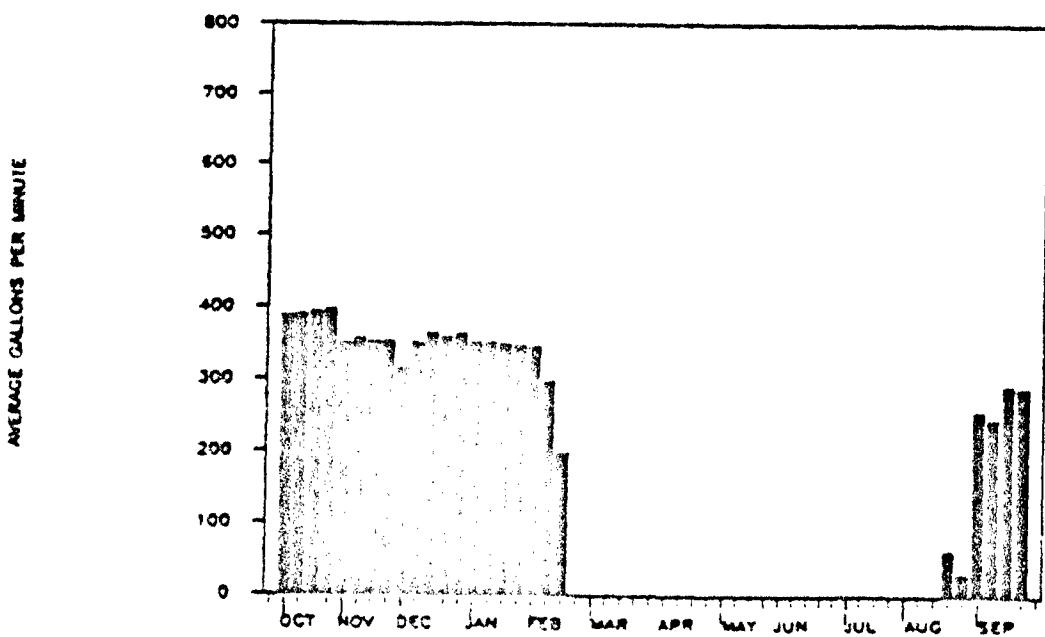


Figure 3. Adsorber 2 flow rate during FY89

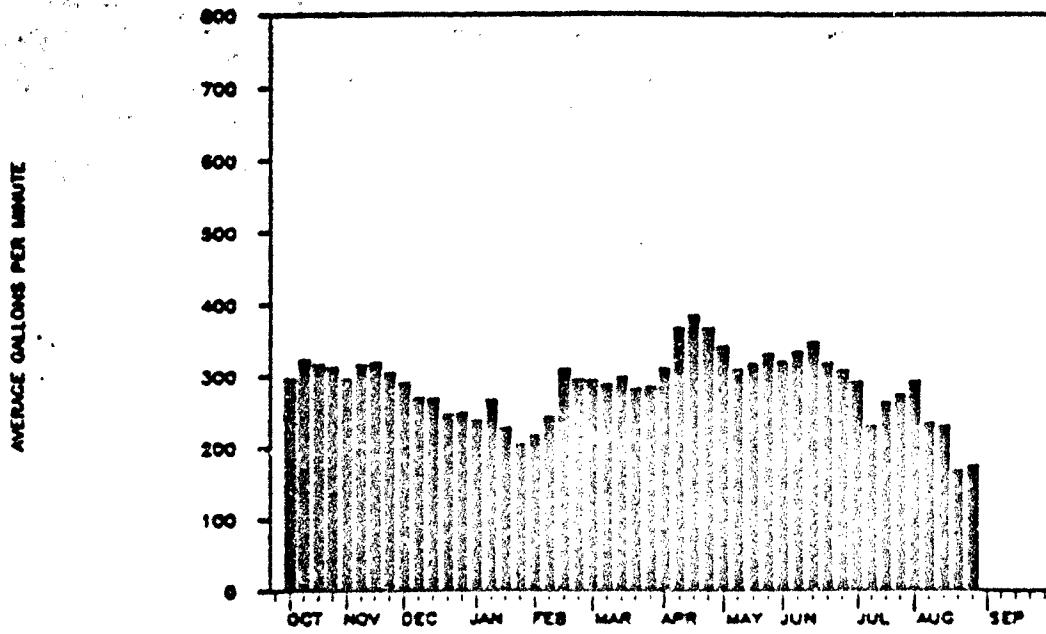


Figure 4. Adsorber 3 flow rate during FY89

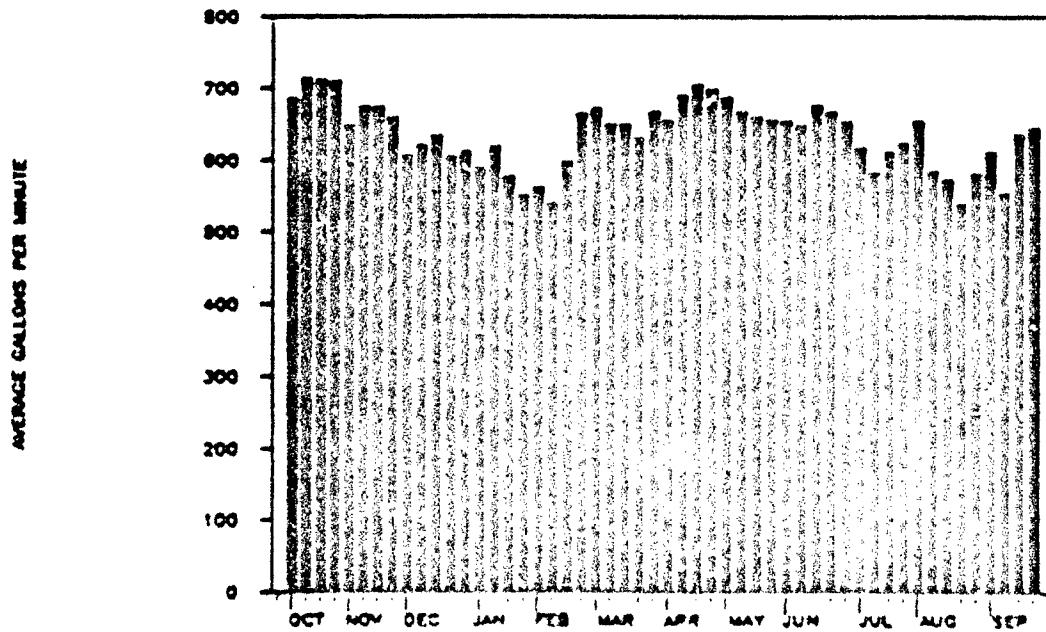


Figure 5. Effluent flow rate during FY89

plant flow data were recorded on a weekly (7 day) basis beginning with the first day of the FY and continuing through the end of the FY.

14. Periods of no flow were experienced by each of the adsorbers during various times of the year (see Figures 2-5). The optimal dewatering/recharge rate can be maintained using two adsorbers in parallel with the third adsorber being maintained in a standby status. During FY89, the total system flow rate (effluent) ranged from a low of 541 gpm to a high of approximately 714 gpm. Average adsorber and total flow rates and total gallons of water treated during FY89 are presented in Table 3. The total volume treated in FY89 was approximately 11.8 million gallons more than that treated in FY88. The average flow rate in FY89 was approximately 24.7 gpm greater than that for FY88. It should be noted that the flow rate through the system was increased at the end of FY88 to improve hydrologic conditions by increasing the volume of recharge along the northwest end of the system (see the FY88 Operational Assessment Report for more details). This increased flow was continued throughout FY89.

Table 3
FY 89 System Flow Quantities

<u>Adsorber</u>	<u>Average Flow Rate (gpm)</u>	<u>Total Volume Treated (gal)</u>
1	214.03	112,680,000
2	156.99	82,727,000
3	265.51	139,161,000
Total Effluent	636.53	334,568,000

System Influent and Effluent Water Quality

15. The quality of the influent and effluent from the treatment system is monitored periodically by taking grab samples and analyzing them. A single sample was collected from the influent sump to determine the quality of water flowing to the adsorbers. A single sample was collected from the effluent sump after treatment.

16. The influent and effluent samples were analyzed for the contaminants listed in Table 1 of this report. A statistical summary of the chemical

analysis data for the period October 1988 through September 1989 are presented in tabular form in Appendix B of this report. Graphs of the concentrations found for aldrin, chloride, chloroform, DIMP, dieldrin, endrin, fluoride, isodrin, parathion, sulfate, tetrachloroethylene, and trichloroethylene, over the reporting period (FY89) have been constructed and are presented in Figures 6 through 17. No concentrations of the other organic contaminants analyzed for in Table 1 in excess of their respective certified reporting limits were found in the samples collected during FY89. Therefore, no graphs were constructed for these undetected contaminants.

17. A separate graph has been constructed for each contaminant detected in the plant influent and effluent. Each graph presents a plot of the contaminant concentration reported and three lines indicating the certified reporting limit (CRL), the maximum operating limit (MOL) permitted, and the average concentration over the FY where sufficient data above CRL were available to calculate an average. The MOL used in this report is defined as the water quality criterion against which the operating performance of the treatment plant is compared in order to assess treatment effectiveness for the various contaminants of concern. A list of the MOL's used during the FY89 operational assessment is presented in Table 4. An average concentration was only computed for sets of data where 70 percent or more of the readings were above the CRL. When the criterion was met, values falling below the CRL were made equal to the CRL and included in the computations.

Aldrin

18. The CRL for aldrin (Figure 6) in FY89 was 0.05 ppb. The MOL for the NWBS treatment plant was 0.2 ppb. Two samples of plant influent out of 52 collected during the year were found to contain aldrin above the CRL with a maximum concentration of approximately 0.1 ppb which is well below the MOL. Three samples of plant effluent were found to contain aldrin in excess of the CRL but all concentrations were below the MOL.

Chloride

19. The CRL for chloride (Figure 7) was not reported. No MOL has been established. The concentration of chloride in the plant influent ranged from 200 ppm to 360 ppm with an average for the year of 260 ppm based on 54 samples. The concentrations in the plant effluent ranged from 200 ppm to 350 ppm with an average for the year of 261 ppm. As evidenced by the data, chloride was not removed from the ground water by the activated carbon treatment system.

Table 4
Maximum Operating Limits for Northwest Boundary System


<u>Parameter</u>	<u>Maximum Operating Limit (MOL)</u>	<u>Source*</u>
Aldrin	0.2 $\mu\text{g/l}$	Guidance from OTSG (Army) until standards are developed.
Chloride	N.A.	EPA Secondary Drinking Water Regulation standard is 250 mg/l
Dibromochloropropane (DBCP)	0.2 $\mu\text{g/l}$	State of Colorado Department of Health limit per letter to Commander, RMA, 26 June 79.
Dicyclopentadiene (DCPD)	24.0 $\mu\text{g/l}$	The State of Colorado has requested the Army to meet a limit of 24 $\mu\text{g/l}$ for DCPD based on an odor threshold value.
Diisopropylmethyl-phosphonate (DIMP)	500 $\mu\text{g/l}^{**}$	These criteria are recommended by the US Medical Bioengineering Research and Development Lab (26 Aug 76) and are based on toxicology studies (26 Aug 76) conducted by the Army. The National Academy of Sciences Committee on Military Environmental Research has reviewed the procedures and results of toxicology studies and concurred in the drinking water levels (1 Feb 77).
Dieldrin	0.2 $\mu\text{g/l}$	Guidance from OTSG (Army) until standards are developed.
Endrin	0.2 $\mu\text{g/l}$	EPA National Primary Drinking Water Regulation.
Fluoride	N.A.	EPA final Rule on Fluoride, National Primary and Secondary Drinking Water Standards, 40 CFR Parts 141, 142, and 143, maximum concentration limit is 4.0 mg/l.

N.A. = Not Applicable

* Source: After Rocky Mountain Arsenal Contamination Control Program Management Team (1983)

** The Environmental Protection Agency's Office of Drinking Water Washington, D.C. issued a health advisory in December 1983 for DIMP not to exceed 600 $\mu\text{g/l}$.

PLANT INFUENT - ALDRN
FY 89

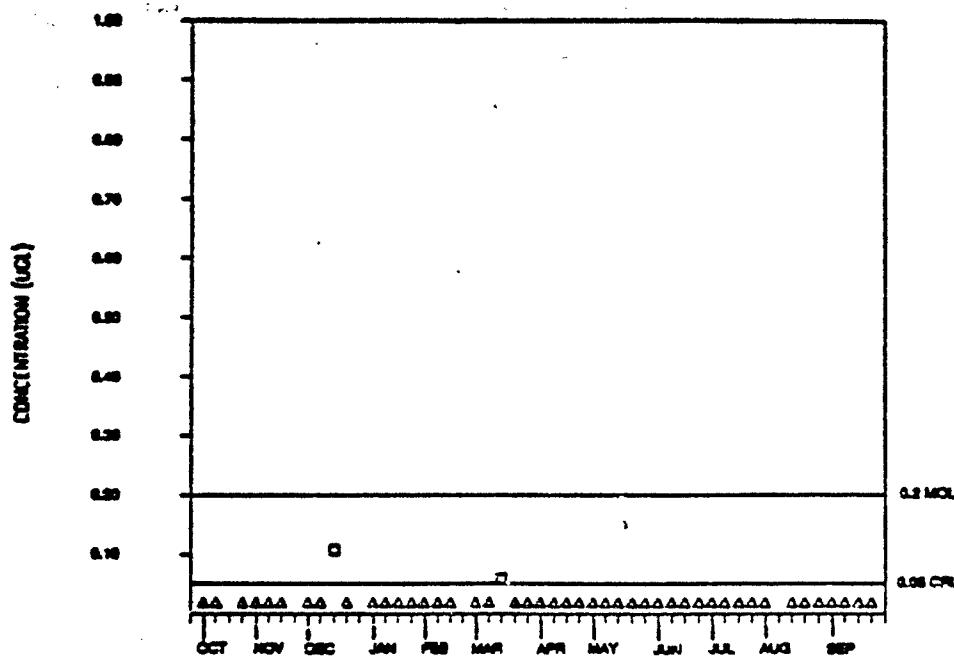

PLANT EFFLUENT - ALDRN
FY 89


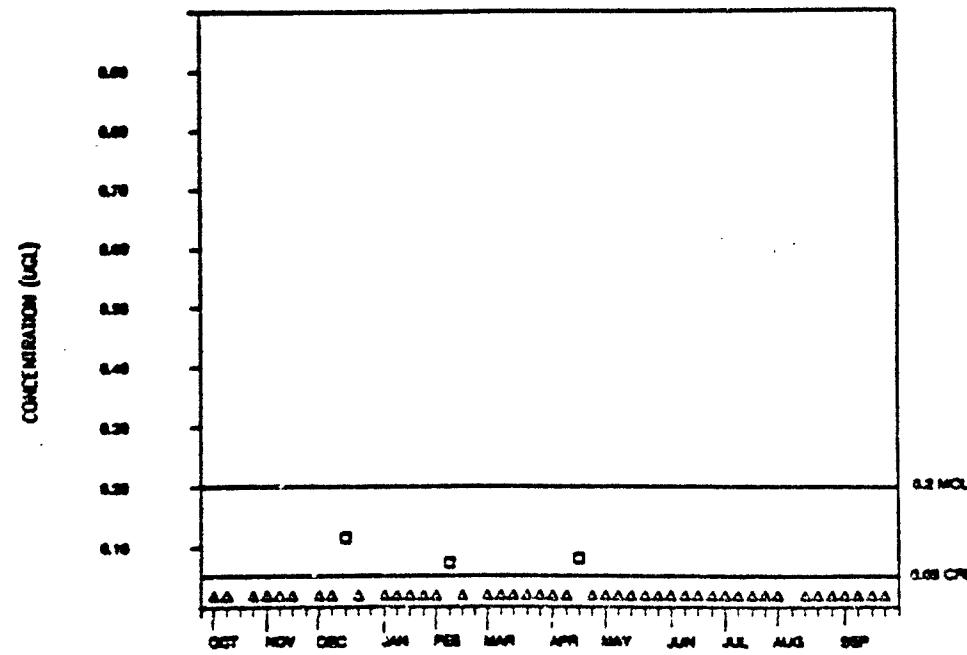


Figure 6. FY89 Aldrin concentrations

PLANT INFLUENT - CHLORIDE

FY 89

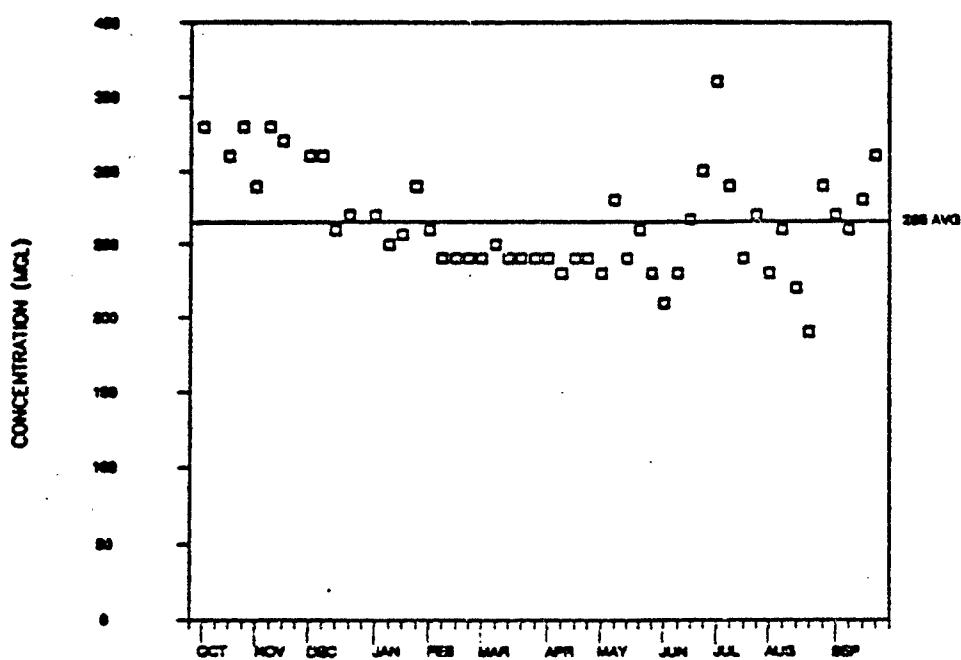

PLANT EFFLUENT - CHLORIDE

FY 89

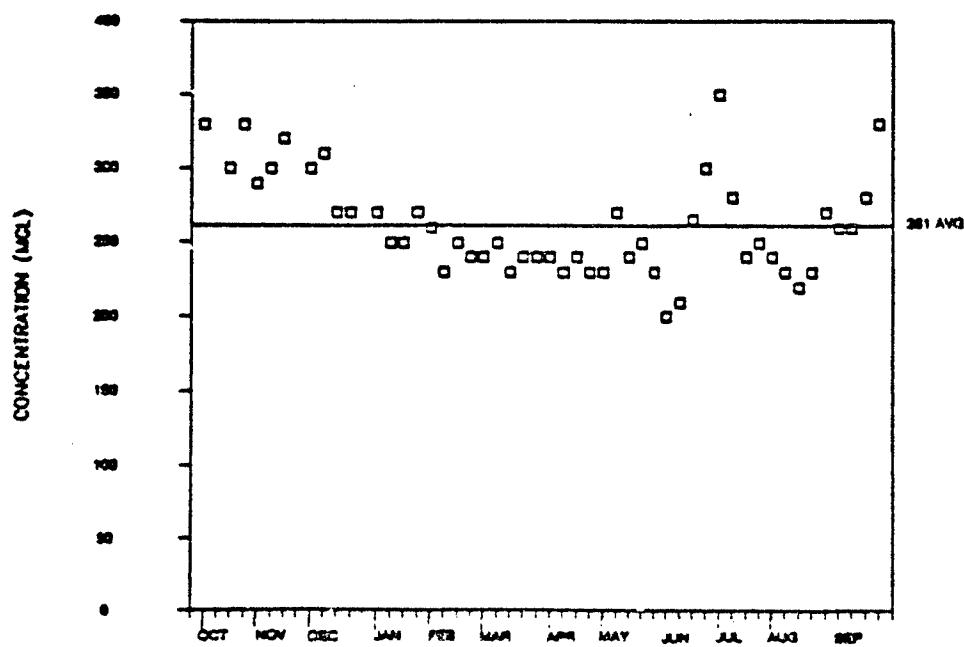


Figure 7. FY89 Chloride concentrations

Chloroform

20. The CRL for chloroform (Figure 8) in FY89 was 0.5 ppb. No MOL has been established. Only two samples each were collected from the plant influent and effluent streams. The maximum concentration in the influent was approximately 49 ppb with an average for the two samples of 34.7 ppb. The highest concentration in the effluent was approximately 23 ppb with an average for the two samples of 21.6 ppb. Chloroform is not as effectively adsorbed by activated carbon as are other organic contaminants found at RMA.

DIMP

21. The CRL for DIMP (Figure 9) in FY89 was 0.65 ppb. The MOL for the NWBS treatment plant was 500 ppb. All of the influent and effluent samples collected during the year, 51 and 49 samples, respectively, had DIMP concentrations in excess of the CRL. The concentrations generally ranged from 2 to 6 ppb with the exception of a sample collected in July, 1989. The influent sample on that date was reported as containing 860 ppb DIMP while the effluent sample was reported as containing 830 ppb. These values are probably anomalous since they are so much higher than any other values reported during the year. As a result, these values were not plotted and were not included in the calculation of the averages. The average DIMP concentrations in the influent and effluent were 3.32 ppb and 4.17 ppb, respectively.

Dieldrin

22. The CRL for dieldrin (Figure 10) in FY89 was 0.05 ppb. The MOL for the NWBS treatment plant was 0.2 ppb. Most of the 53 influent samples collected during the year had dieldrin concentrations in excess of the CRL. The maximum concentration reported was approximately 0.65 ppb. The average concentration in the influent over the year was 0.4 ppb. Only four samples of plant effluent were found to contain dieldrin in excess of the CRL with a maximum concentration of approximately 0.19 ppb. Thus, effluent concentrations did not exceed the MOL during FY89.


Endrin

23. The CRL for endrin (Figure 11) in FY89 was 0.05 ppb. The MOL for the NWBS treatment plant was 0.2 ppb. Only one sample of plant influent out of the 53 collected had an endrin concentration slightly in excess of the CRL. No concentrations of endrin above the CRL were found in the plant effluent.

Fluoride

24. The CRL for fluoride (Figure 12) was not reported. No MOL has been established. Concentrations of fluoride in the plant influent ranged from

PLANT INFLUENT - CHCL₃
FY 89

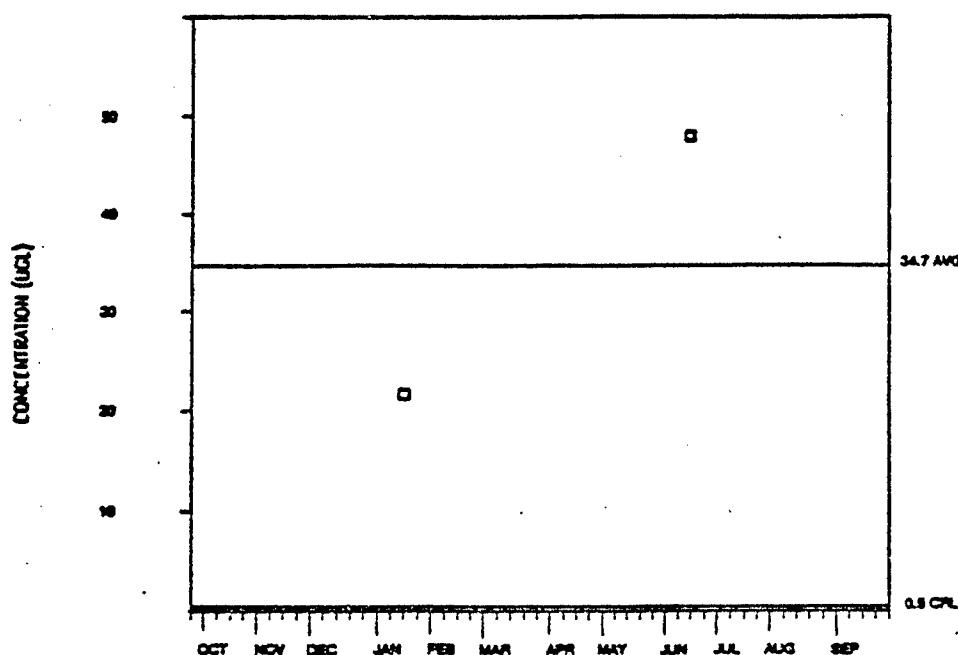

PLANT EFFLUENT - CHCL₃
FY 89

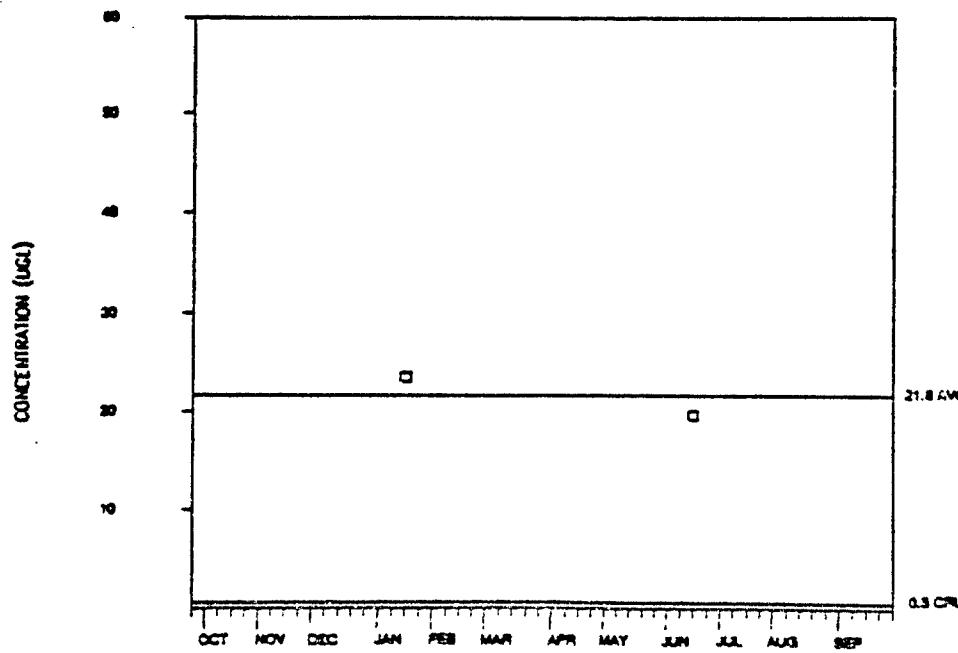


Figure 8. FY89 Chloroform (CHCL₃) concentrations



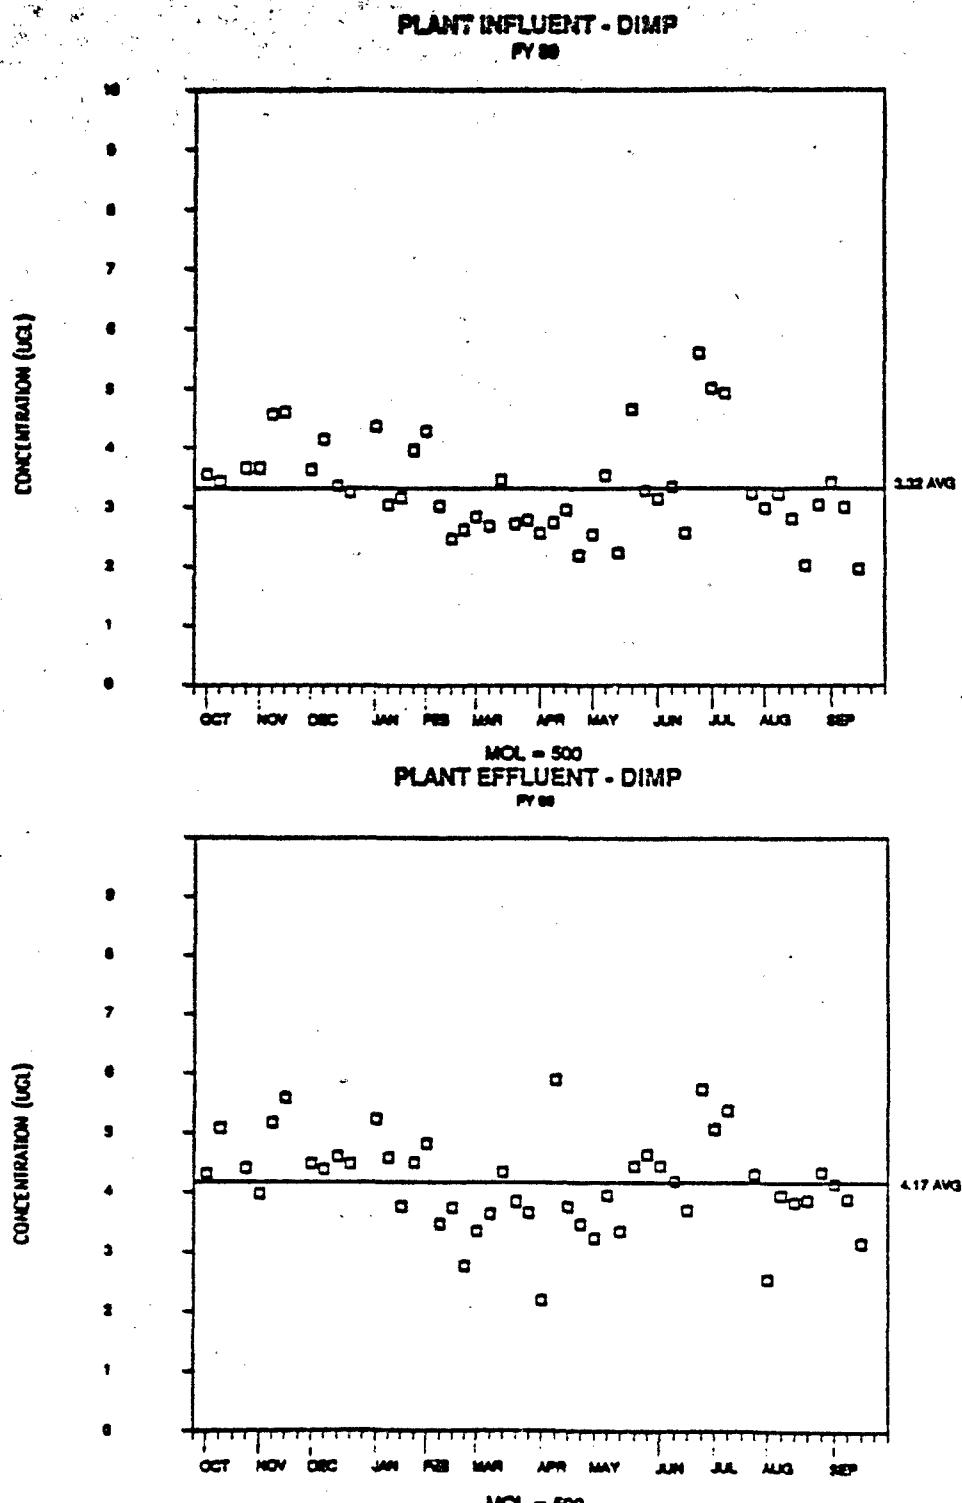


Figure 9. FY89 Diisopropylmethylphosphonate (DIMP) concentrations

PLANT INFLUENT - DLDRN
FY 89

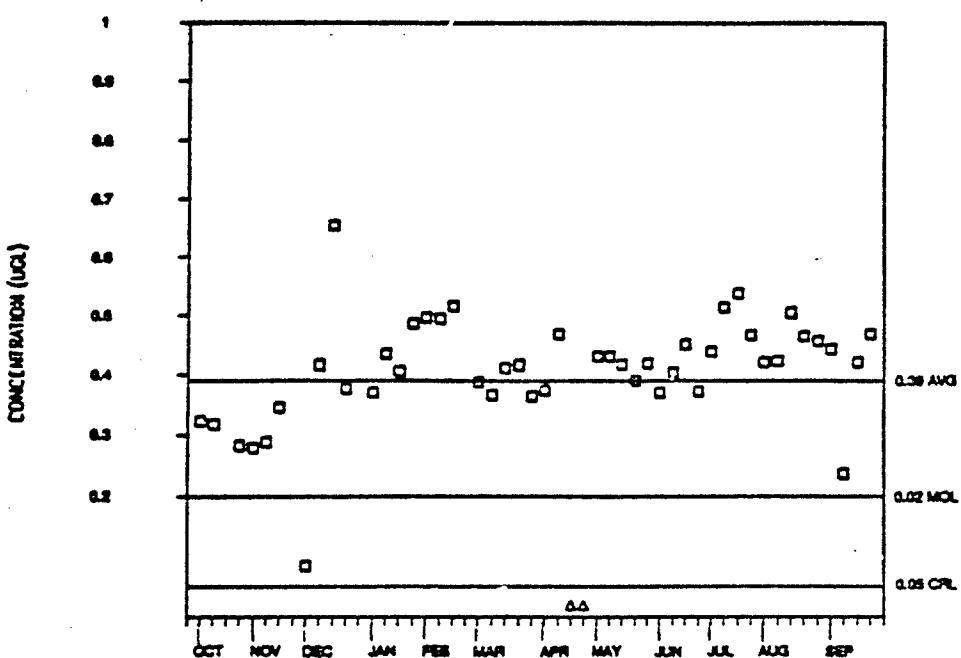

PLANT INFLUENT - ENDRN
FY 89

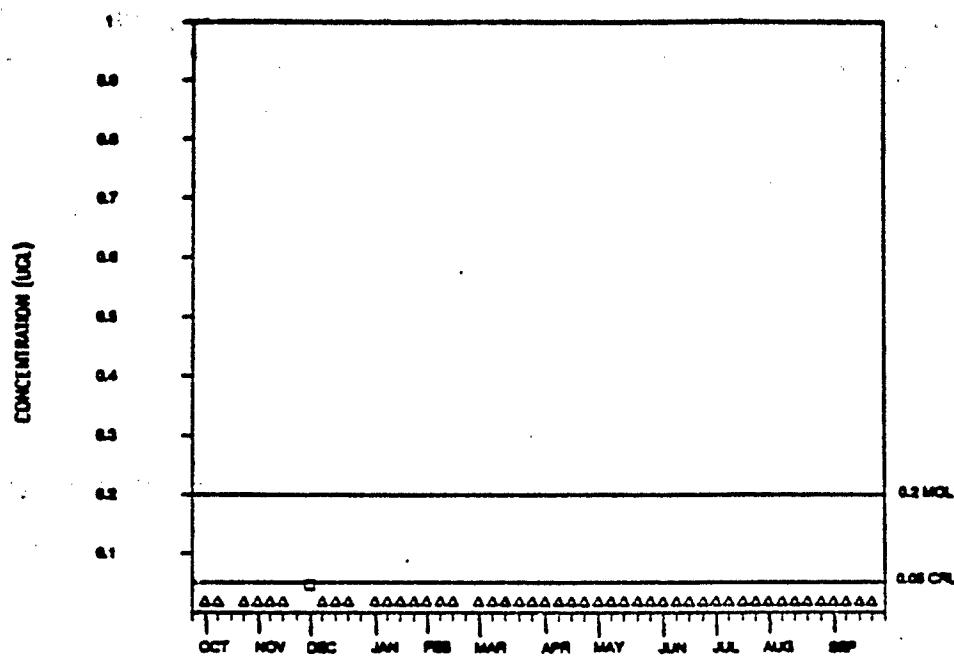

PLANT EFFLUENT - ENDRN
FY 89


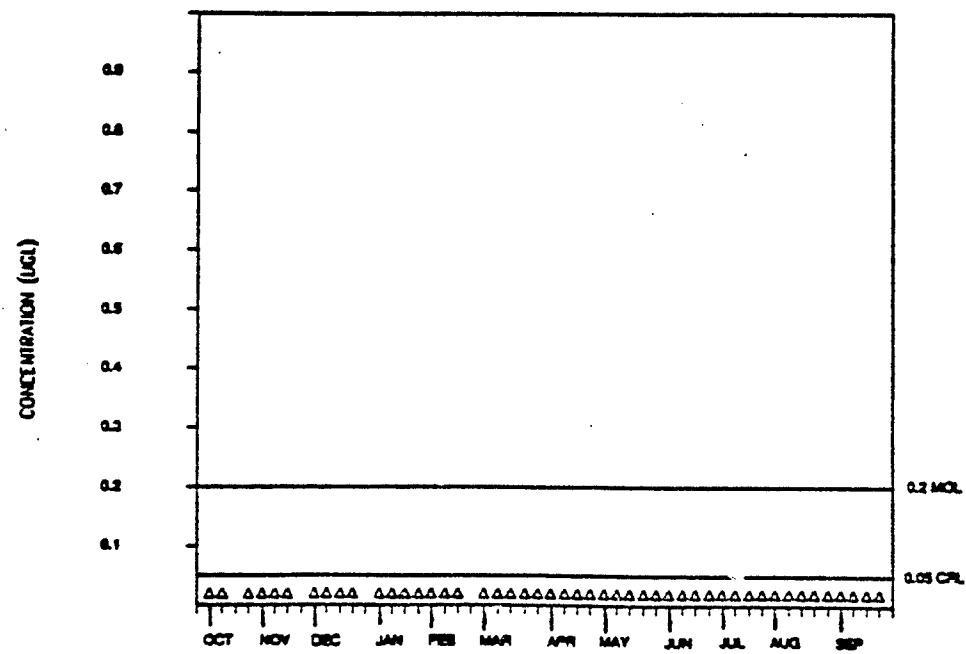


Figure 11. FY89 Endrin concentrations

PLANT INFLUENT - FLUORIDE
FY 89

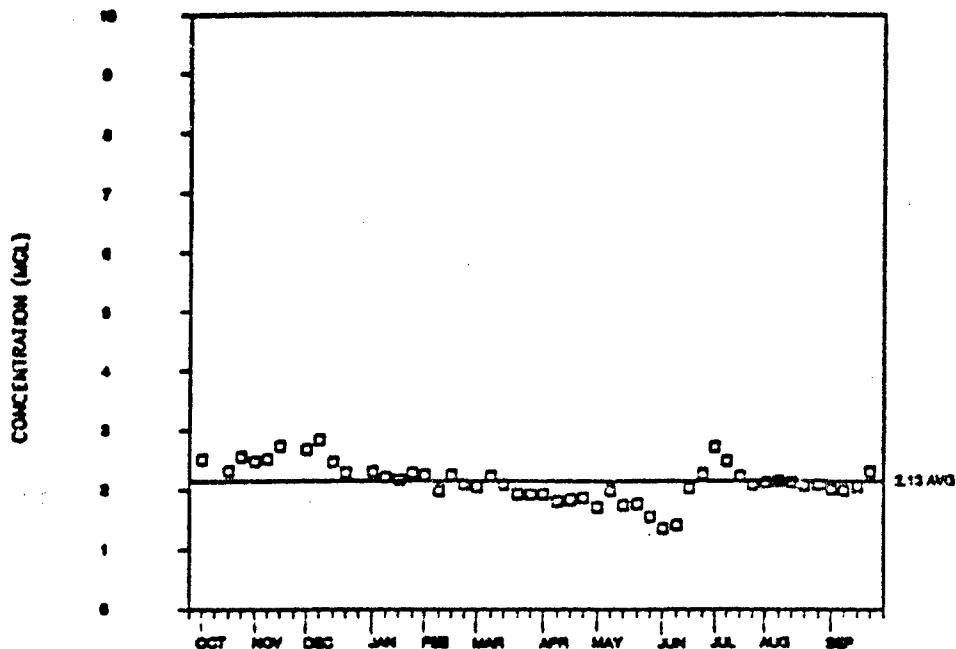

PLANT EFFLUENT - FLUORIDE
FY 89

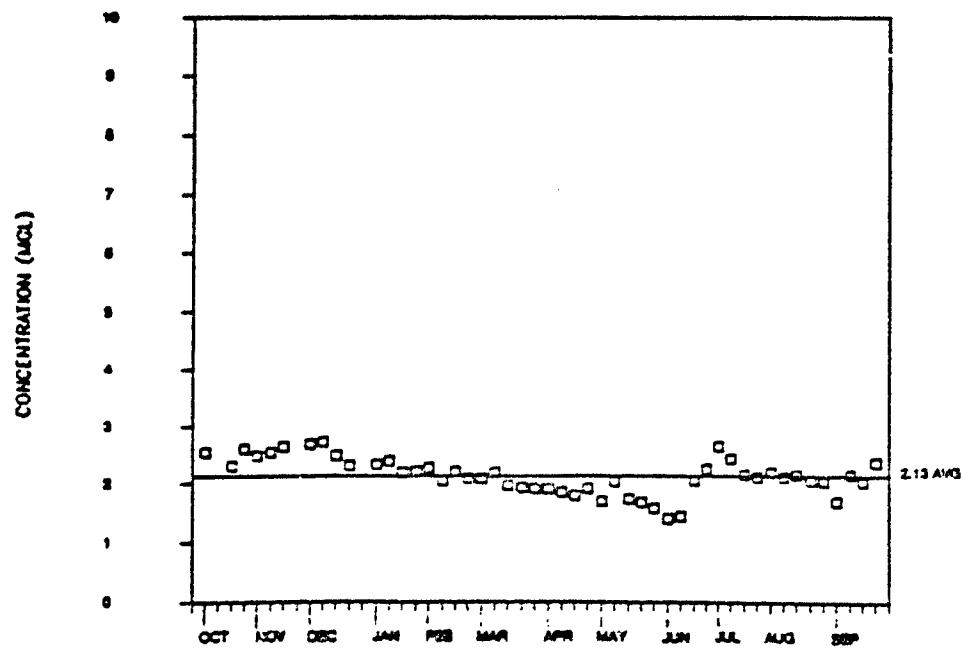


Figure 12. FY89 Fluoride concentrations

1.4 ppm to 2.8 ppm with an average for the year of 2.1 ppm. The concentrations in the plant effluent ranged from 1.4 ppm to 2.7 ppm with an average of 2.1 ppm. As the data indicate, fluoride was not removed from the ground water by the activated carbon treatment system.

Isodrin

25. The CRL for isodrin (Figure 13) was 0.051 ppb in FY89. No MOL has been established. Five influent samples out of the 53 collected during the year had isodrin concentrations above the CRL with a maximum reported concentration of 0.09 ppb. No concentrations of isodrin above the CRL were found in the plant effluent.

Parathion

26. The CRL for parathion (Figure 14) in FY89 was 0.647 ppb. No MOL has been established. Only two samples each were collected from the plant influent and effluent streams during the year. One of the samples of influent had a concentration of 1.8 ppb parathion while the other was below the CRL. One of the samples of effluent had a concentration of 1.7 ppb parathion while the other sample was reported to be less than the CRL.

Sulfate

27. The CRL for sulfate (Figure 15) was not reported. No MOL has been established. Only two samples each were collected from the plant influent and effluent streams during the year. The average concentrations for both the influent and effluent were 135 ppm. As the data indicate, sulfate was not removed from the ground water by the activated carbon treatment system.


Tetrachloroethylene

28. The CRL for tetrachloroethylene (Figure 16) was 0.75 ppb in FY89. No MOL has been established. Only one sample was collected from each of the plant influent and effluent streams during the year. The tetrachloroethylene concentration in the influent sample was below the CRL while the concentration in the effluent sample was approximately 2 ppb.

Trichloroethylene

29. The CRL for trichloroethylene (Figure 17) was 0.56 ppb in FY89. No MOL has been established. Only one influent sample out of the 54 collected had a trichloroethylene concentration in excess of the CRL at approximately 0.9 ppb. No concentrations of trichloroethylene above the CRL were found in the plant effluent.

PLANT INFLUENT - ISODR
FY 89

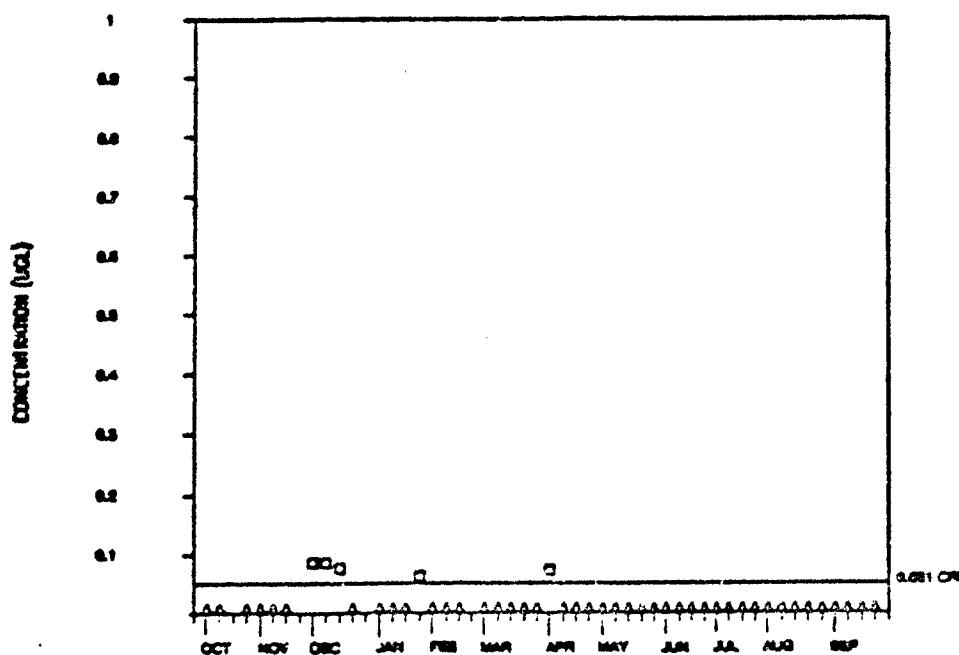

PLANT EFFLUENT - ISODR
FY 89

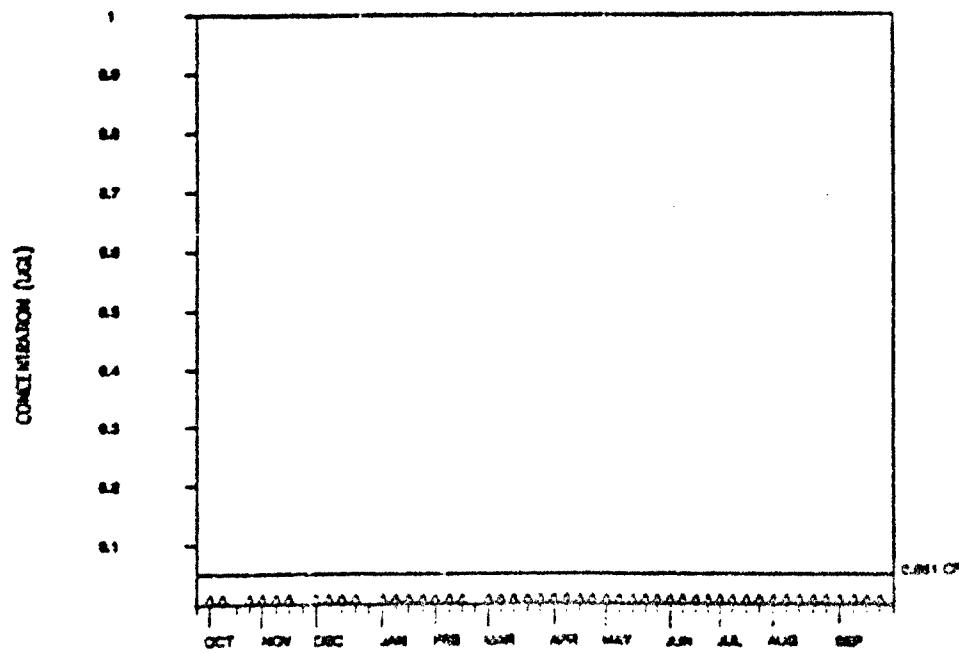


Figure 13. FY89 Isodrin concentrations


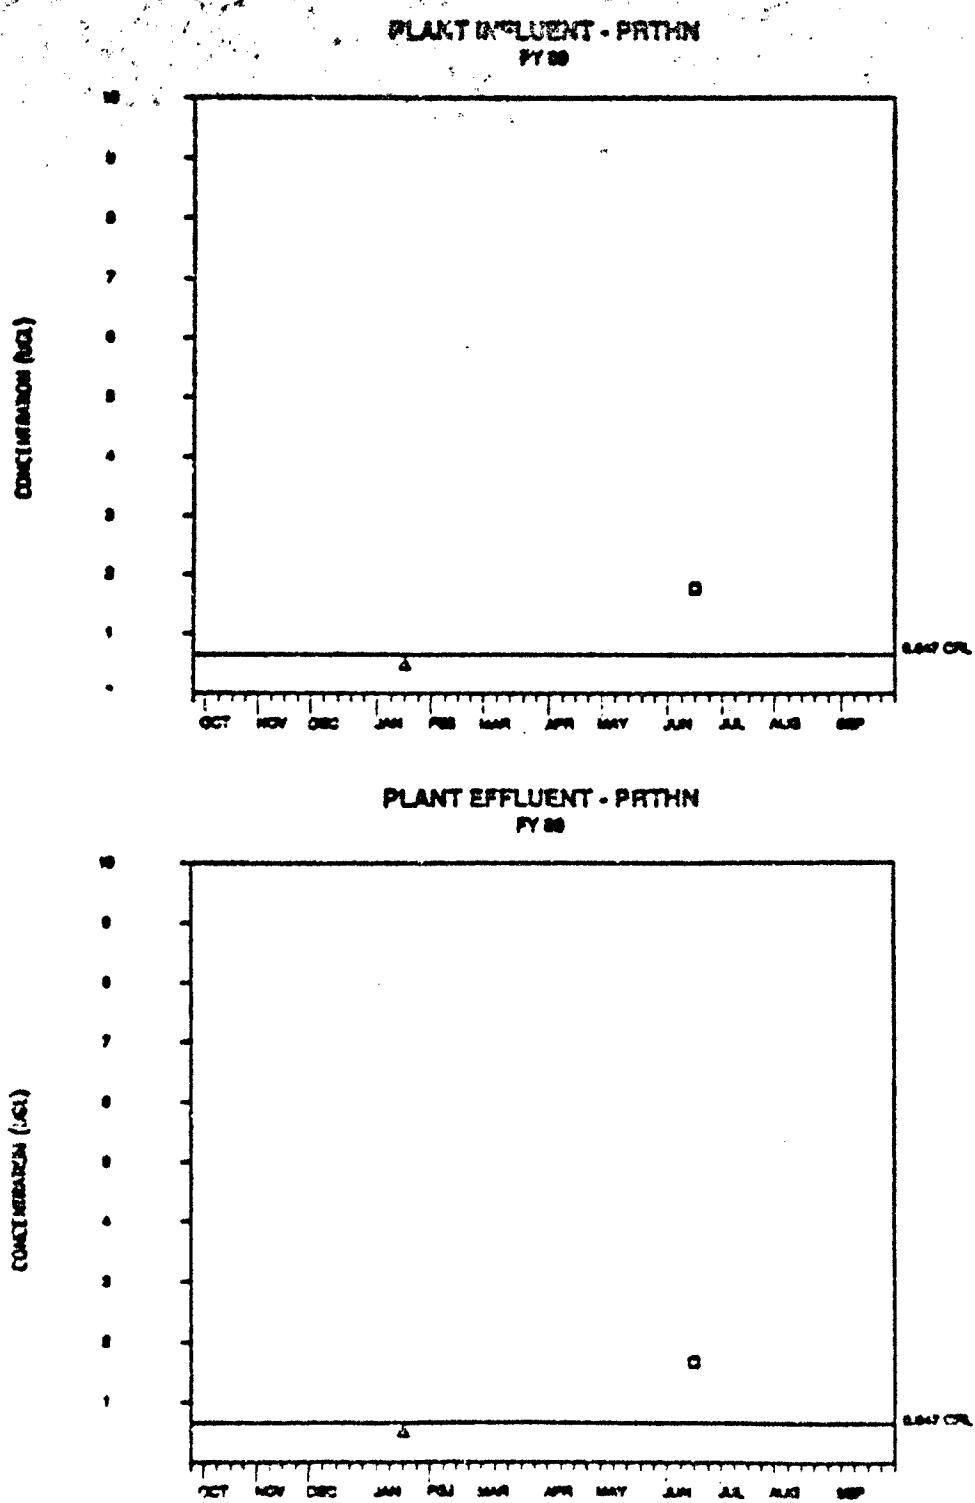


Figure 14. FY89 Parathion concentrations

PLANT INFLUENT - SO₄
FY 89

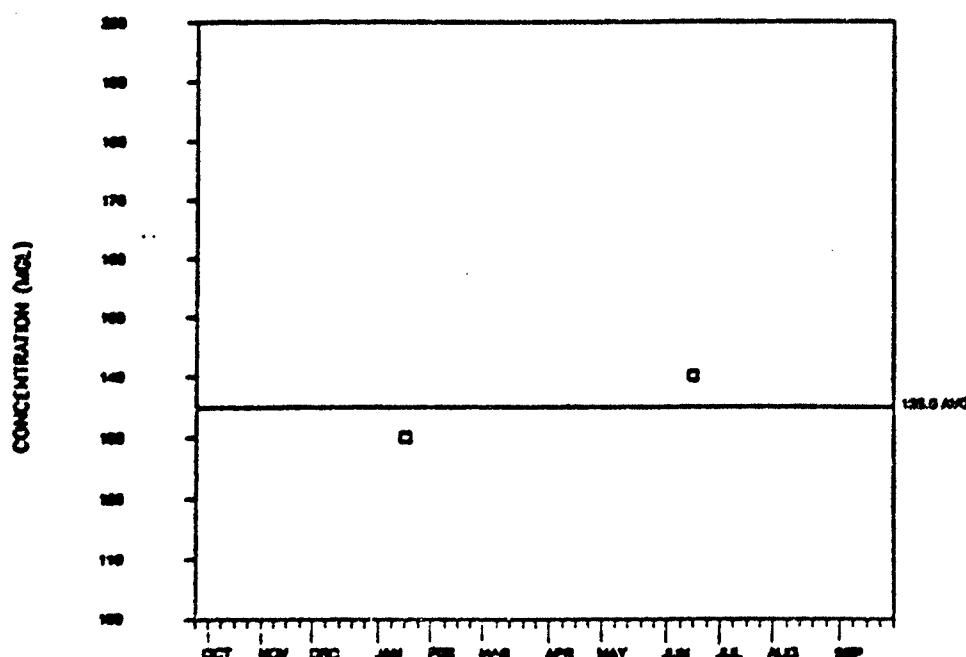

PLANT EFFLUENT - SO₄
FY 89

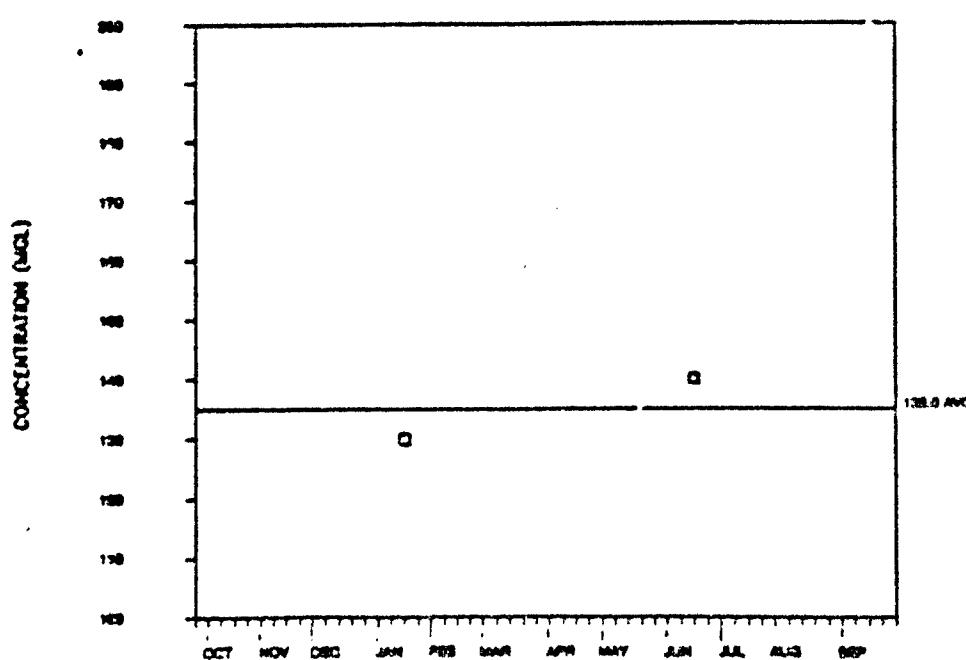


Figure 15. FY89 Sulfate (SO₄) concentrations


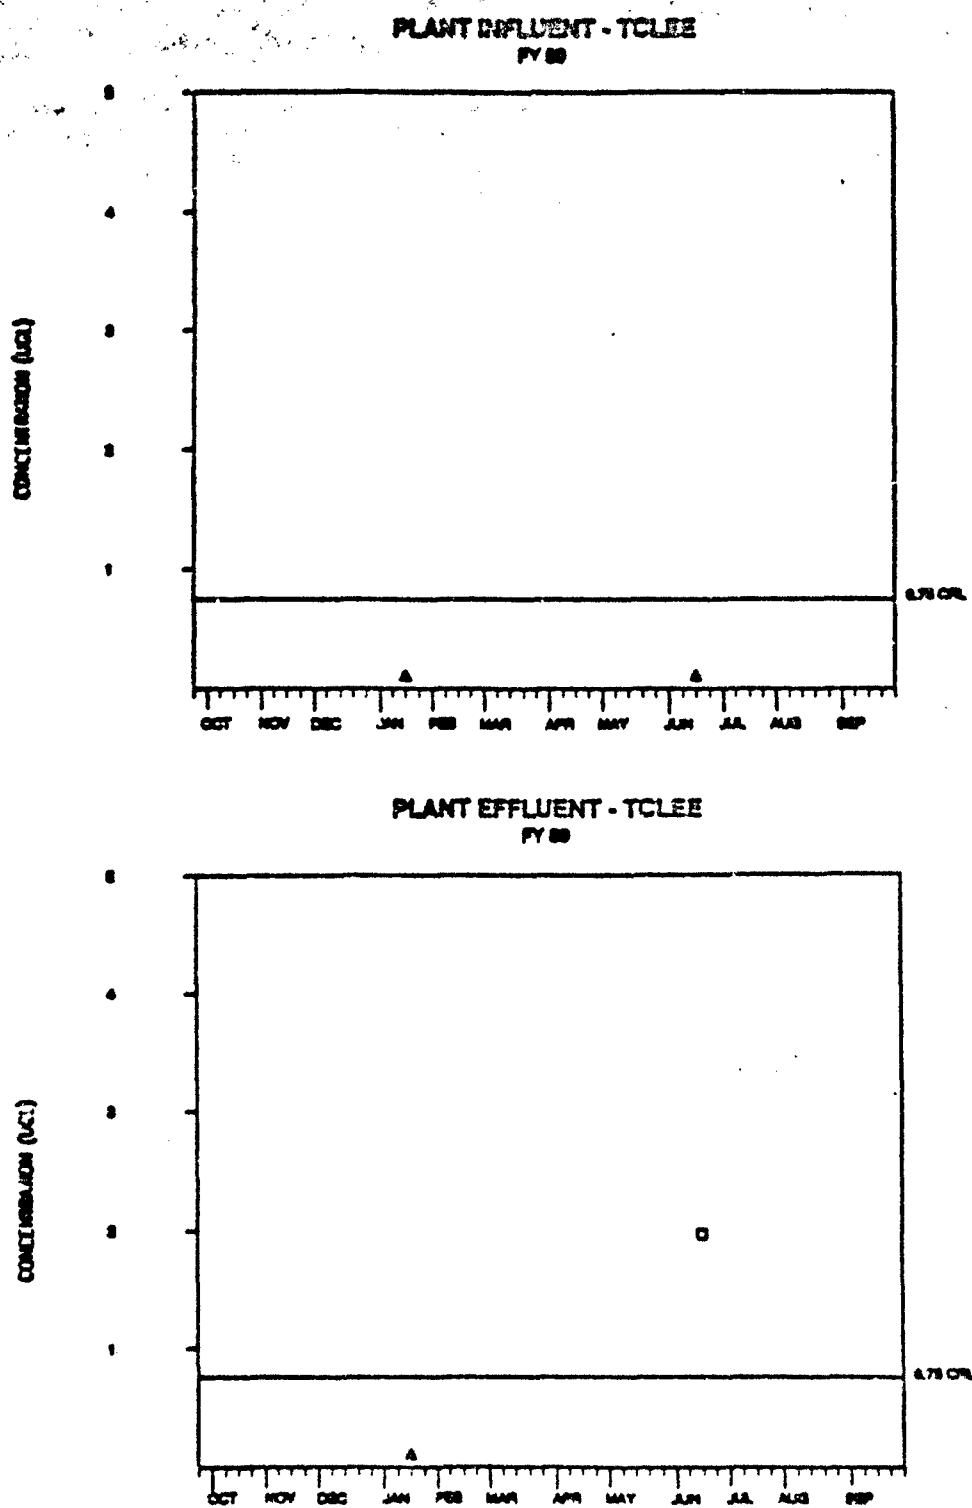


Figure 16. FY89 Tetrachloroethylene (TCLEE) concentrations

PLANT INFLUENT - TRCLE
FY 89

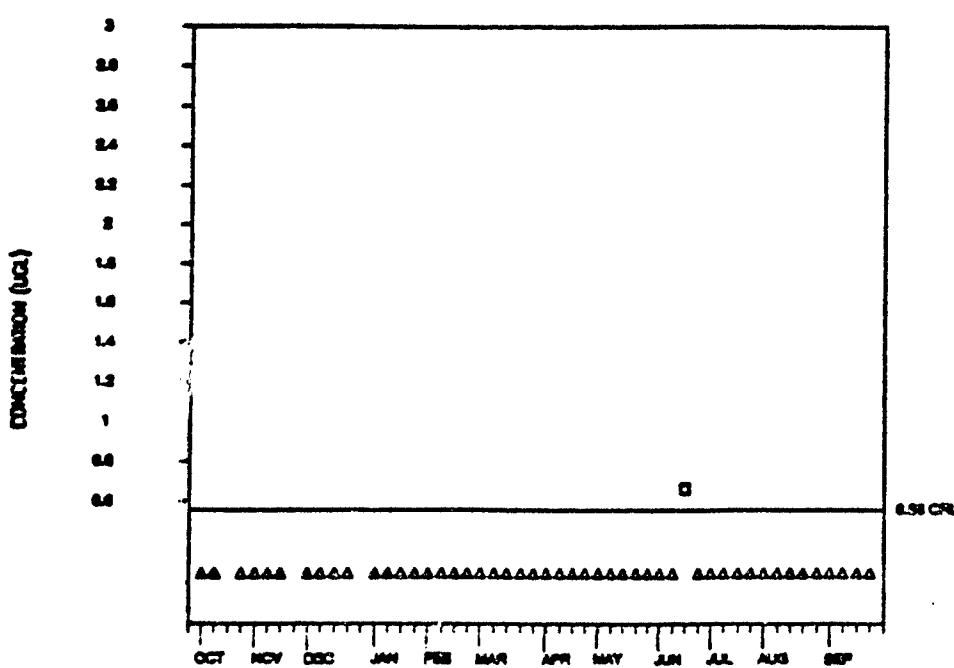

PLANT EFFLUENT - TRCLE
FY 89

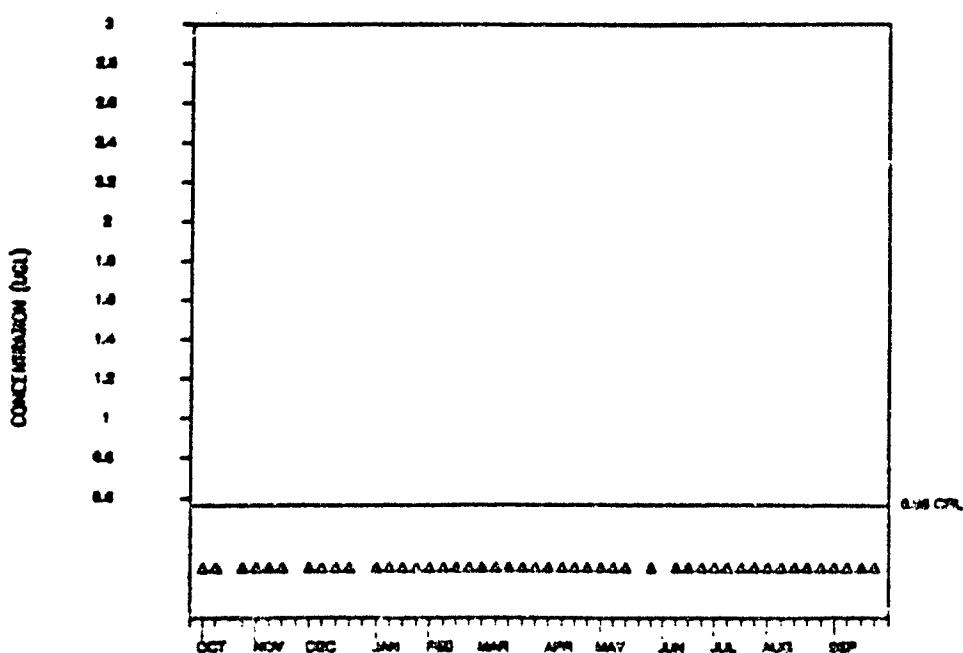


Figure 17. FY89 Trichloroethylene (TRCLE) concentrations

GC/MS Analysis

30. GC/MS analyses were conducted on influent and effluent samples collected in June, 1989. The results of the analysis are presented in Appendix B. No concentrations of contaminants above their respective detection levels were reported in either the influent or effluent sample.

Summary of System Water Quality Data

31. The NWES treatment plant was generally successful in removing organic contaminants from the ground water treated during FY89. Of the organics analyzed for on a weekly basis, only DIMP was routinely found in the plant effluent at concentrations above the CRL. The DIMP concentrations were two orders of magnitude below the MOL with the exception of one sample collected in July 1989. The result reported for that date is considered anomalous. Several effluent samples collected during the year were found to contain aldrin and dieldrin concentrations in excess of their respective CRL's, however all the concentrations were below their respective MOL's.

32. Of the organics analyzed for only once or twice a year, chloroform, parathion, and tetrachloroethylene were found in effluent samples above their respective CRL's. Due to the limited number of samples collected, it is difficult to determine whether the CRL's are exceeded routinely or only occasionally. Analysis of more samples for these contaminants are needed over the year in order to determine realistic average effluent concentrations.

Contaminant Mass Removal

33. A calculation of the total mass of contaminants removed by the NWBS treatment system during FY87, FY 88, and FY89 was conducted by the Technical Operations Division as part of a multi-year study on all the water treatment systems in operation at RMA. A summary of the results from this study for the NWBS is present in Table 5. The amount of contaminants removed is given in pounds with a total for FY87, FY88, and FY89 of approximately 16, 18, and 3 pounds respectively. The contaminants with the largest amounts removed include chloroform, dicyclopentadiene, and dieldrin. The calculations were conducted using a simple mass balance. Average annual effluent concentrations were subtracted from average influent concentrations. Values less than the detection limits on CRL were treated as zero. The calculated values vary between years depending primarily on the average influent concentrations of the contaminants.

Table 5
Northwest Boundary System Contaminant Removal, FY87-FY89

<u>Contaminant</u>	<u>Abbreviation</u>	<u>Pounds Removed</u>		
		<u>FY87</u>	<u>FY88</u>	<u>FY89</u>
Chloroform	CHCL3	9.95	14.04	1.78
Combined Organo-Sulfur	CPMSOX	0.00	1.15	0.00
Dibromochloropropane	DBCP	0.01	0.00	0.00
Dicyclopentadiene	DCPD	2.88	1.56	0.00
Dieldrin	DLDRN	0.68	0.79	1.47
Tetrachloroethylene	TCLEE	1.21	0.00	0.00
Trichloroethylene	TRCLE	1.06	0.00	0.05
Other Organics		<u>0.15</u>	<u>0.06</u>	<u>0.12</u>
TOTALS		15.93	17.60	3.42

Carbon Usage

34. Carbon usage in the NWBS treatment plant is very low compared to the North Boundary System treatment plant, due to the lower total mass of contamination being removed. No carbon was added to any of the adsorbers during FY89.

Contaminant Concentrations in Dewatering Wells

35. In order to provide a picture of the distribution of contaminants in the ground water near the NWBS, contaminant concentrations found associated with each alluvial dewatering well were plotted with respect to the well number along the dewatering well line. Thus, each graph provides a visual representation of a particular contaminants distribution along the length of the system. Based on the availability of data, graphs were developed only for aldrin, chloride, DCPD, DIMP, dieldrin, endrin, fluoride, isodrin, and trichloroethylene for FY89. These graphs are presented in Figures 18 through 26. Each graph presents the data collected for each well during the year. The vertical lines associated with each well number represent the range of concentrations found (maximum and minimum) with the mean value for each well connected by a dotted line. A mean value was only computed for sets of

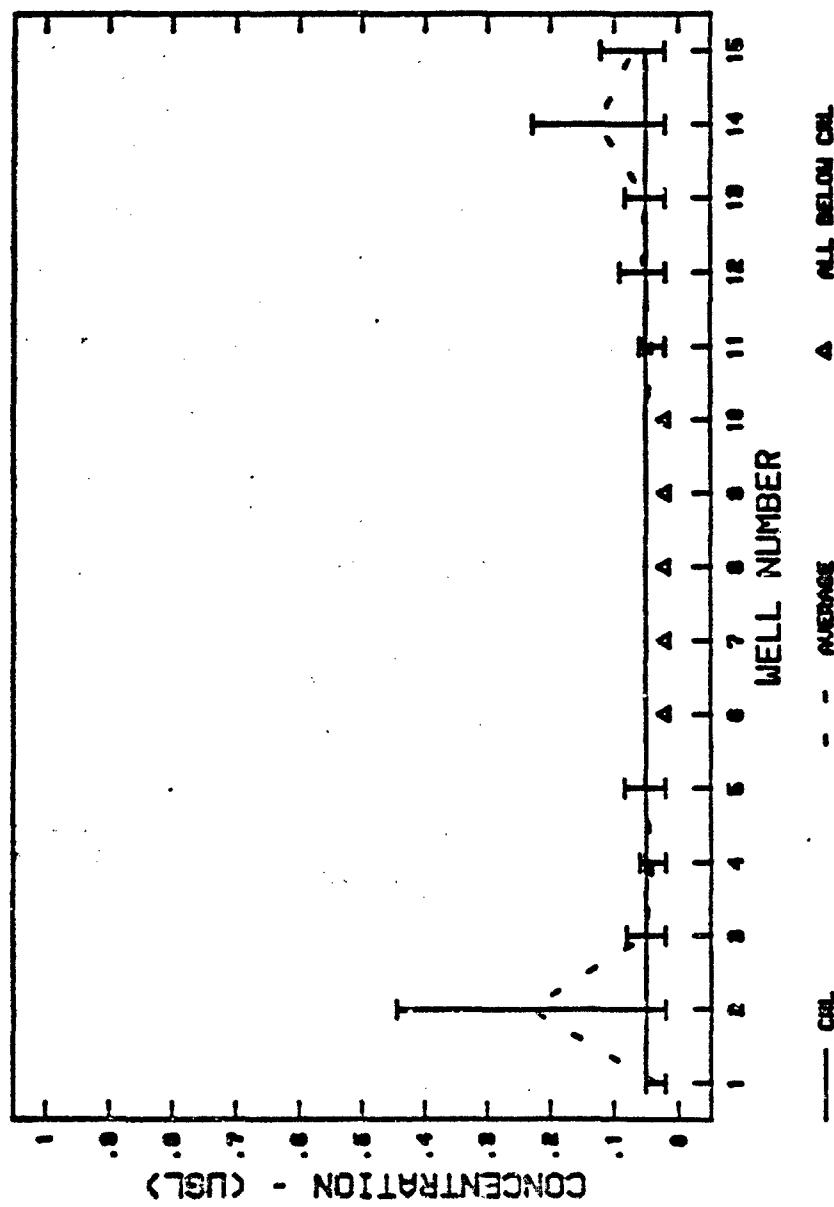


Figure 18. FY89 Aldrin concentration in NWBS dewatering wells

data where 70 percent or more of the readings were above the CRL. When this criterion was met, values falling below the detection limit were made equal to the detection limit or CRL and included in the computations. A single triangle indicates that all values were below the detection limit or CRL. A statistical summary of all the data used to develop the graphs is presented in Appendix C. It should be noted that the maximum number of samples collected from each well was five with only two samples collected in some cases.

Aldrin

36. During FY89, concentration of aldrin (Figure 18) above the CRL were found in samples collected from dewatering wells on the northeast and southwest ends of the control system. The maximum concentration found on the southwest end was approximately 0.45 ppb in well No. 2. The maximum concentration found on the northeast end was approximately 0.22 ppb in well No. 14. No concentrations above the CRL were found associated with well No.'s 6 through 10. The distribution of aldrin along the dewatering well line in FY89 was somewhat similar to that found in FY88, however concentrations above the CRL were found associated with more wells on each end of the system. The concentrations of aldrin found in FY89 were somewhat higher than those reported in FY88.

Chloride

37. The highest concentrations of chloride (Figure 19) during FY89 were found along the northeast end of the control system with a maximum concentration of approximately 800 ppm found associated with well No. 14. The maximum mean concentration on the northeast end of the system was approximately 600 ppm. The chloride concentrations decreased from northeast to southwest along the system with concentrations in the 150 to 200 ppm range found in samples from the southwest end. The distribution of chloride along the dewatering well line in FY89 was very similar to that found in FY88. However, concentrations found in FY89 were somewhat lower than those reported in FY88.

DCPD

38. During FY89, concentrations of DCPD (Figure 20) above the CRL were found associated with well No.'s 2 and 3 with a maximum concentration of approximately 15 ppb reported for well No. 3. None of the other dewatering wells produced samples with DCPD concentrations above the CRL. No DCPD concentrations above the CRL were reported for the dewatering wells in FY88.

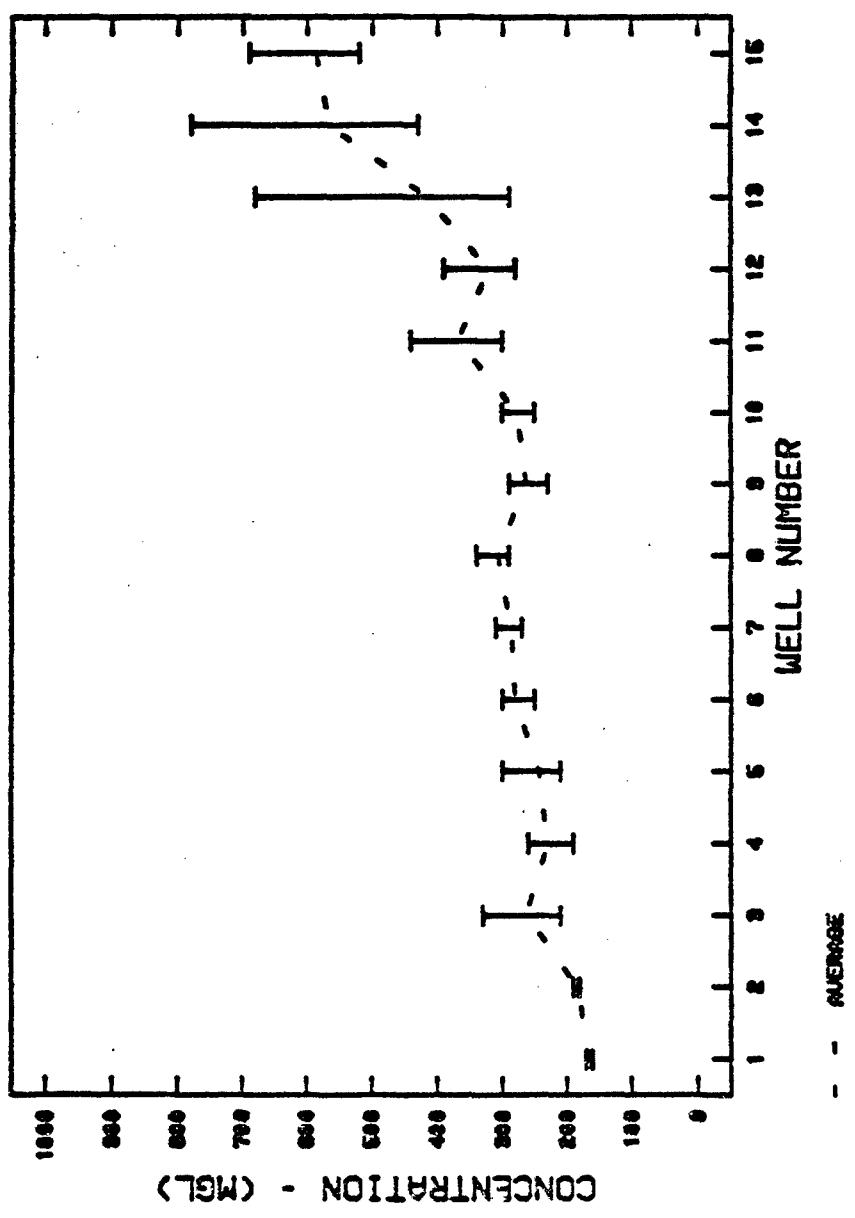


Figure 19. FY89 chloride concentration in NWBS dewatering wells.

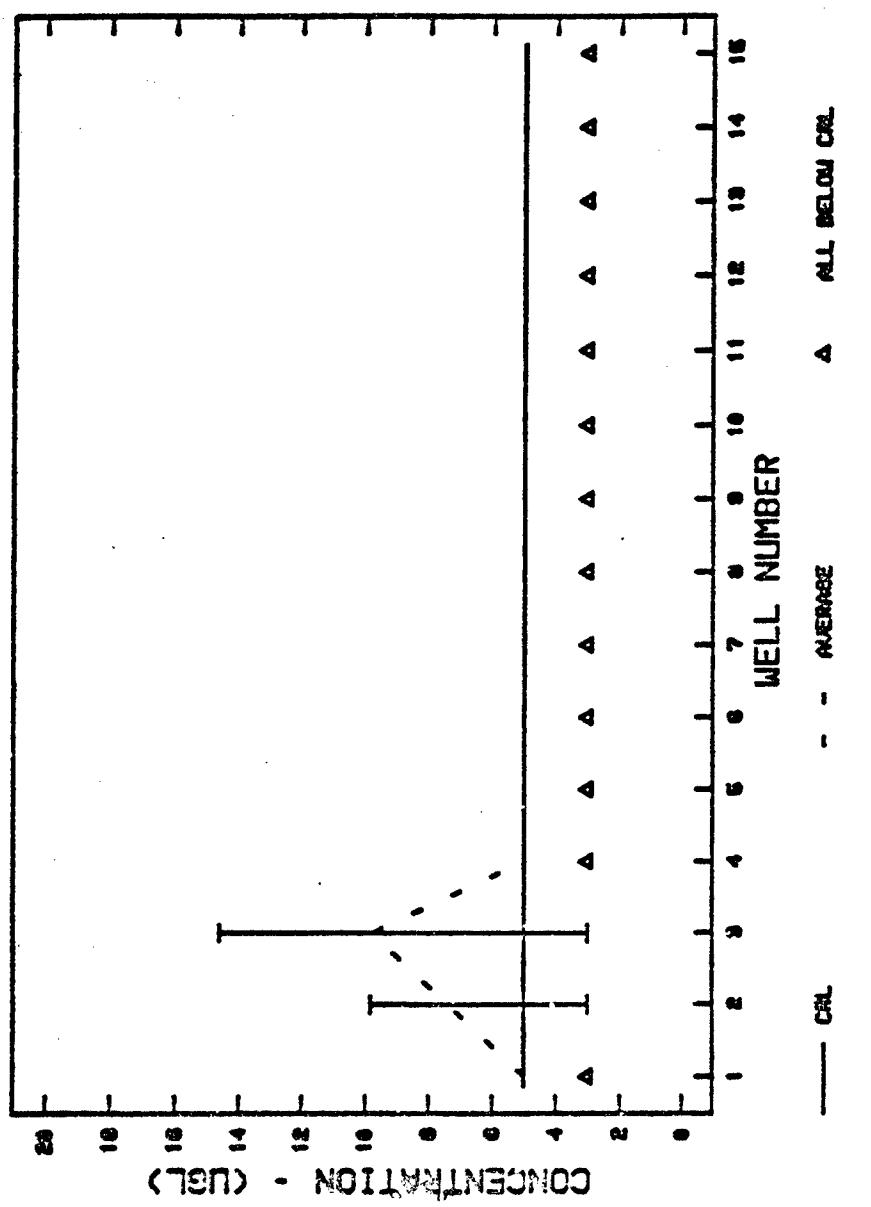


Figure 20. FY89 Dicyclopentadiene (DCPD) concentrations in NWBS dewatering wells

DIMP

39. During FY89, concentrations of DIMP (Figure 21) above the CRL were found in samples from all the dewatering wells except No.'s 1 and 2. The concentrations generally increased from southwest to northeast along the system with the highest concentrations reported for well No.'s 13 through 15. The mean concentration values along the line were generally less than 10 ppb. The distribution of DIMP along the dewatering well line in FY89 was somewhat similar to that found in FY88. The concentrations of DIMP reported in FY89 were lower along the northeast end of the system than those reported in FY88.

Dieldrin

40. During FY89, concentrations of dieldrin (Figure 22) above the CRL were found in samples from all the dewatering wells except No. 9. The concentrations were generally below 1 ppb with the exception of the northeast end of the dewatering well line where a maximum concentration of approximately 7 ppb was reported for well No. 13. The distribution of dieldrin along the system was very similar to that reported in FY88. The concentrations of dieldrin reported in FY89 were generally higher than those reported in FY88, particularly along the northeast end of the system.

Endrin

41. During FY89, concentrations of endrin (Figure 23) above the CRL were found in samples collected from dewatering wells on the northeast and southwest ends of the control system. The maximum concentration found on the southwest end was approximately 0.5 ppb in well No. 2. The maximum concentration found on the northeast end was approximately 0.2 ppb in well No. 14. No concentrations above the CRL were found associated with well No.'s 3 through 12 or with well No. 1. Only one endrin concentration above the CRL (in well No. 6) was reported for the dewatering wells in FY88.

Fluoride

42. In FY89, a general increasing trend in fluoride concentration was found from the southwest to the northeast end of the system (Figure 24). A maximum concentration of fluoride of approximately 5 ppm was reported for well No.'s 8, 13 and 15. The average concentrations found associated with the wells generally ranged from 1.5 to 4 ppm. The distribution and concentrations of fluoride found in FY89 did not vary significantly from those found in FY88.

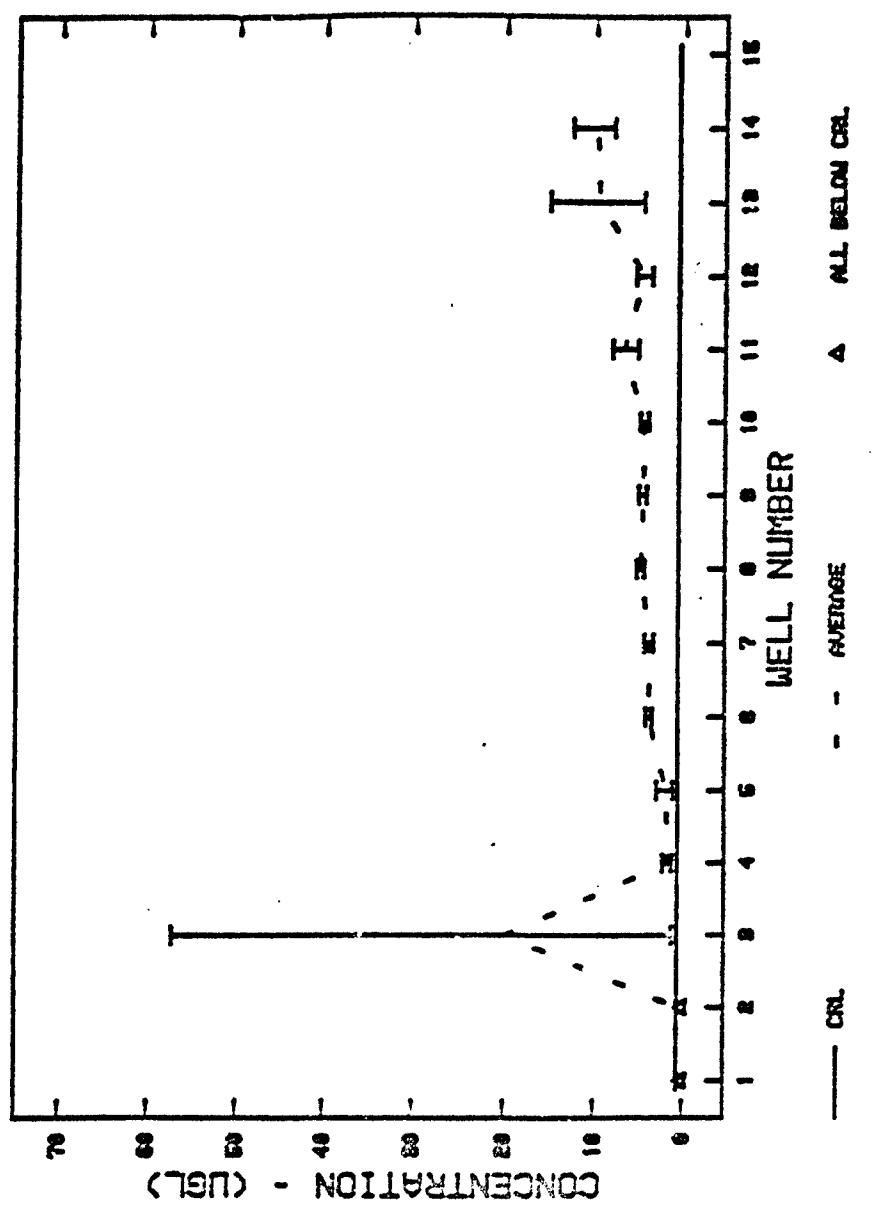


Figure 21. FY69 Disopropylmethylphosphonate (DIMP) concentrations in NBS dewatering wells

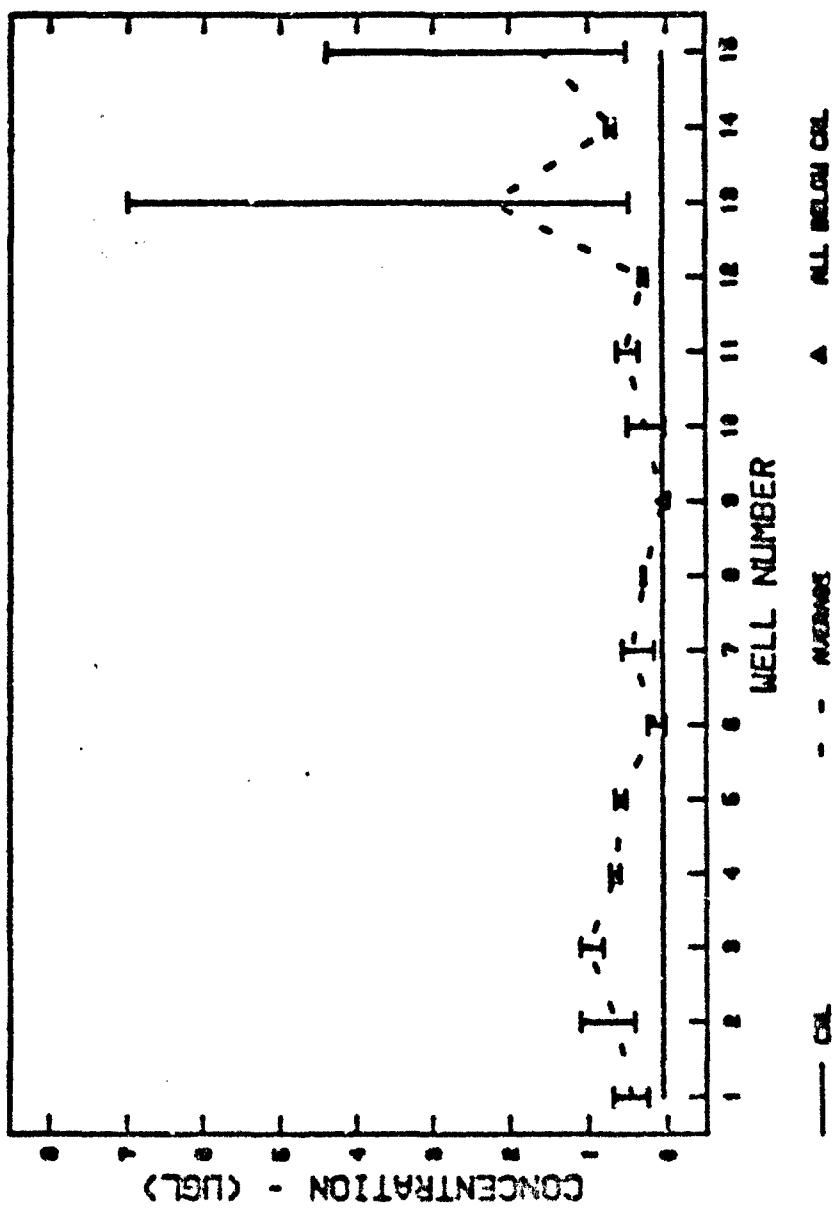


Figure 22. Fy89 Dieldrin concentration in NMNS dewatering wells

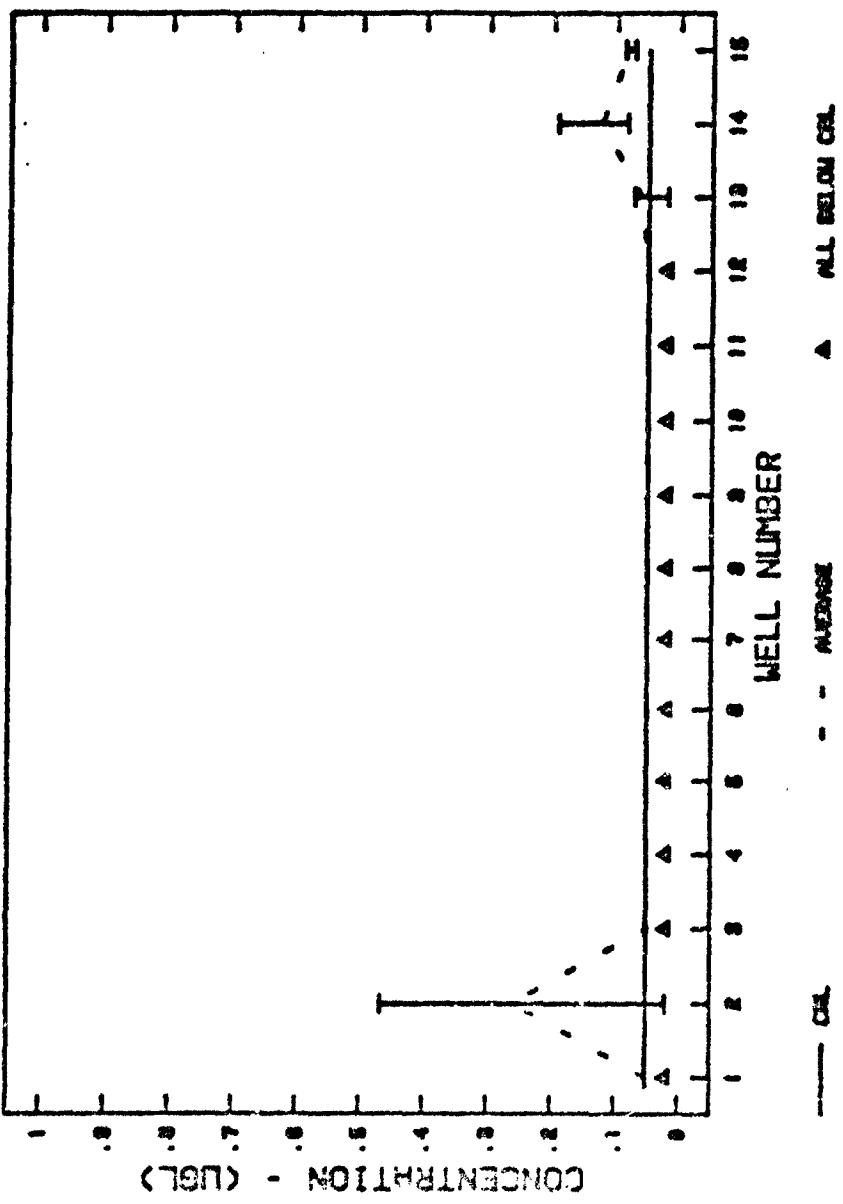


Figure 23. FY89 Endrin concentrations in NWBS dewatering wells

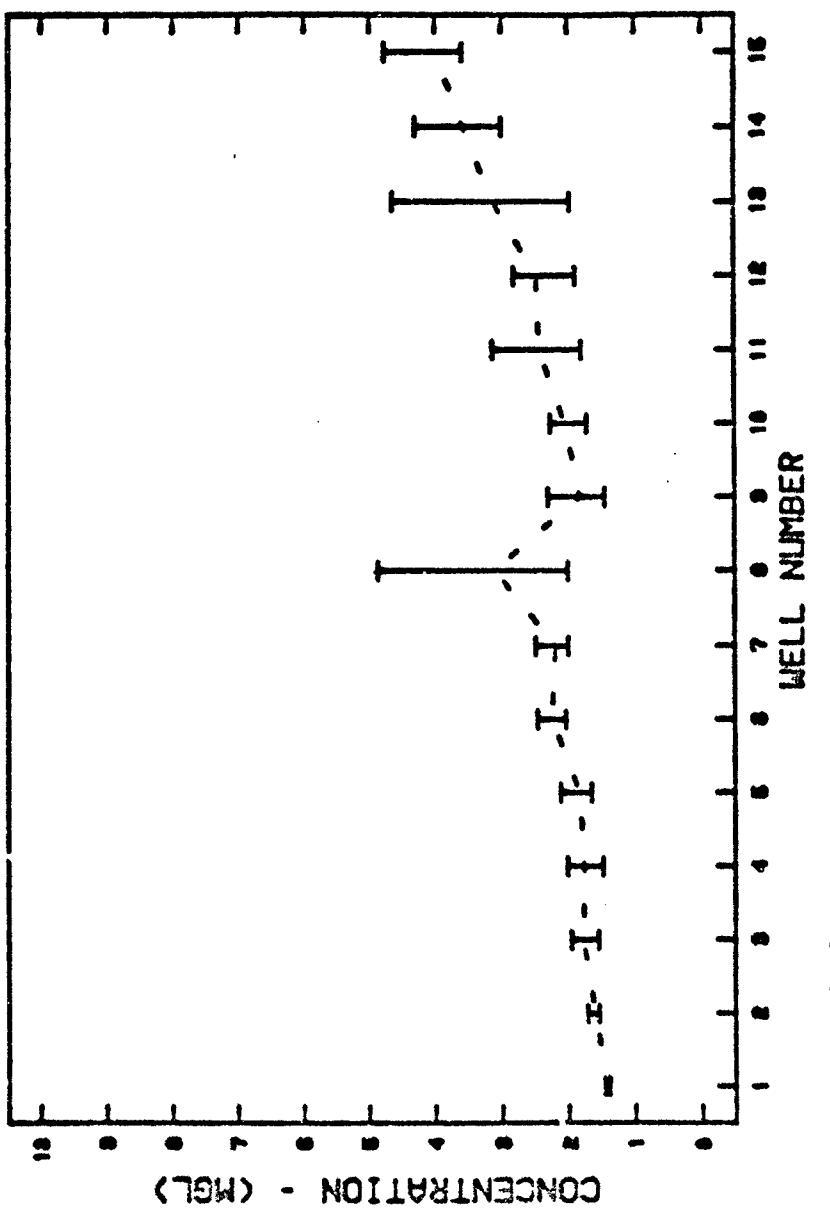


Figure 24. F-89 Fluoride concentrations in MWBS dewatering wells

Isodrin

43. During FY89, concentrations of isodrin (Figure 25) above the CRL were found in samples collected from wells located generally along the northeast half of the system. A maximum concentration of approximately 0.65 ppb was reported for well No. 10. Isodrin concentrations along the southwest end of the line were generally below the CRL. No isodrin concentrations were reported for the dewatering wells in FY88.

Trichloroethylene

44. During FY89, concentrations of trichloroethylene (Figure 26) above the CRL were found in samples collected from wells located along the northeast end of the system. A maximum concentration of approximately 1.4 ppb was reported for well No. 14. Trichloroethylene concentrations were reported to be below the CRL for well No.'s 1 through 10 and No. 12. No trichloroethylene concentrations were reported for the dewatering wells in FY88.

Summary of Dewatering Well Data

45. Based on the contaminant concentration data collected for the dewatering wells during FY89, it appears that the highest concentrations of aldrin, DCPD, dieldrin, endrin, isodrin, and trichloroethylene were found along either or both ends of the dewatering well line with essentially no concentrations above their respective CRL's found along the center of the line. With respect to chloride, DIMP, and fluoride, the concentrations increased from southwest to northeast along the line. Of those contaminants for which values were not reported in FY88, isodrin and trichloroethylene concentrations above their respective CRL's with wells along the northeast end of the line while DCPD concentrations above the CRL were found along the southwest end of the line.

46. With respect to overall trends in the FY89 distributions of the individual contaminants reported in FY88, there was not a lot of change. However, additional contaminants with concentrations above their respective CRL's have been found on both ends of the system. With respect to FY89 concentrations of contaminants reported in FY88, fluoride remained about the same while aldrin, and dieldrin concentrations increased slightly. Chloride and DIMP concentrations decreased somewhat.

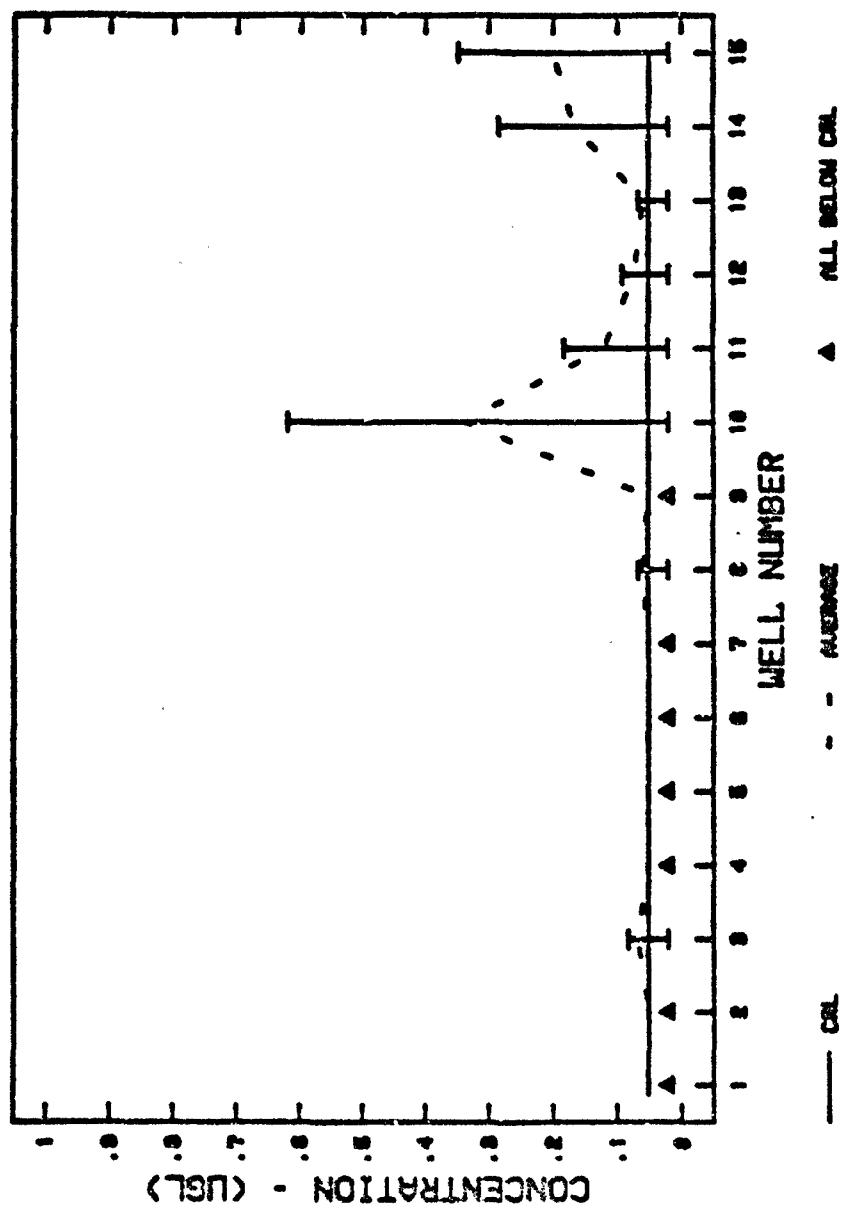


Figure 25. FY89 Isodrin concentrations in NWBS dewatering wells

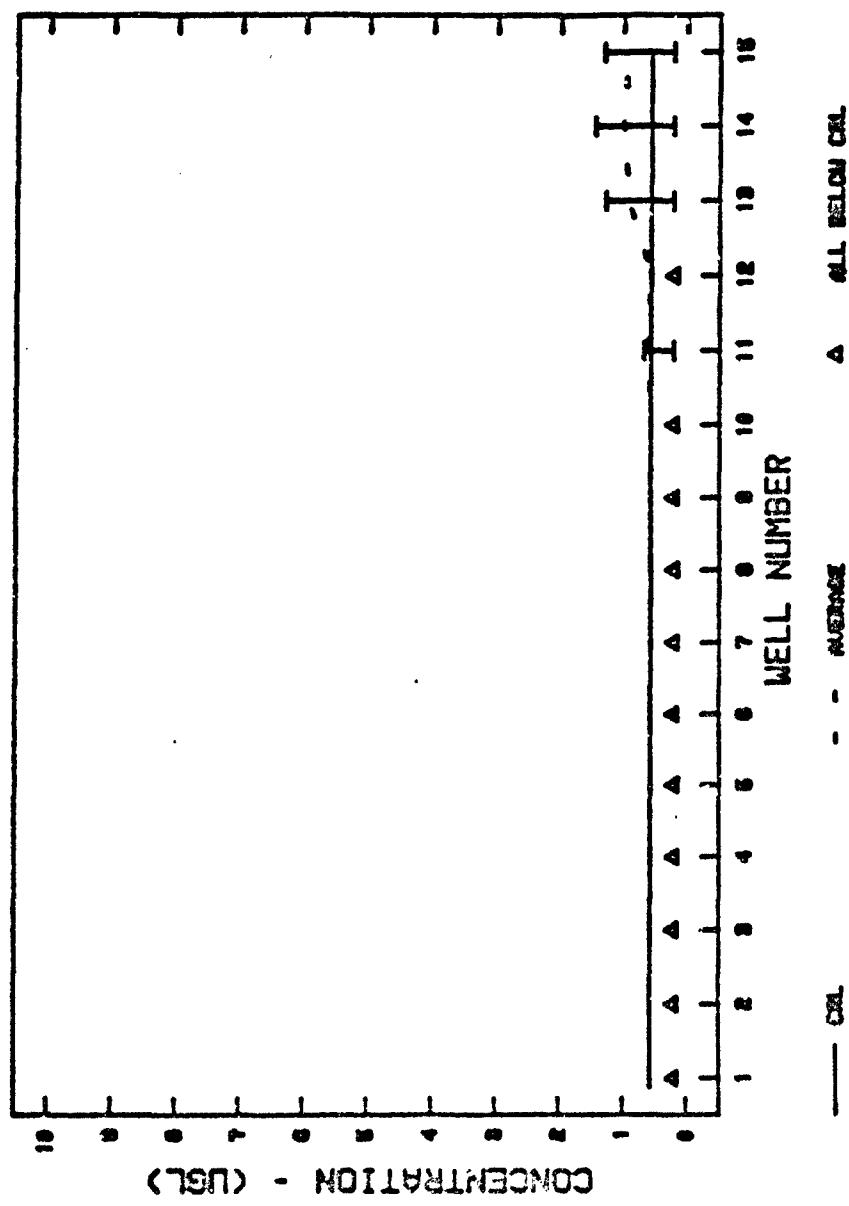


Figure 26. FY89 Trichloroethylene (TCE) concentrations in NWS dewatering wells

PART IV: GROUND-WATER FLOW EVALUATION

Geology and Hydrogeology

Geological Setting

47. Description of the geology at the Northwest Boundary area has been presented adequately in previous assessment reports and is not repeated here.

Start of Year Alluvial Hydrogeology

48. Hydrogeological conditions in alluvium at the start of FY89 were in continuity with conditions for the past few years. Figure 27 shows the configuration of the water table in October 1988. The map is generated mostly by computer and is distinct in appearance from maps in previous years which were contoured by hand with geological interpretation.*

End of Year Alluvial Hydrogeology

49. Hydrogeological conditions in alluvium at the end of FY89 are shown in Figure 28. Readings on about October 13, 1989 are representative of the end of FY89 despite falling two weeks into FY90.

50. Comparison of the map for the end of the year with the map for the start of the year (Figure 27) reveals the major rise in water table that took place on both sides of the barrier. The rise is shown separately in Figure 29. Water continued to rise through most of the year as evident in the

* The computer program for contouring entitled MCCON, was developed by the Geotechnical Laboratory, WES. The program is written in FORTRAN and operates on a PC ("286" or "386" IBM compatibles). MCCON is used to prepare contour maps and to prepare section profiles. The program will accept up to 999 data (x,y,z) triplets. MCCON was chosen for this project because it is capable of handling the discontinuous behavior of the water table in the vicinity of the slurry walls. The program generates non-intersecting triangles which connect each and every data (node) point. Triangle generation ceases after all of the nodes are used as a vertex of at least one triangle and the mesh of triangles encompasses all of the nodes in a convex fashion (i.e., the outer edges of the triangle mesh form a convex shape). The resulting mesh will contain no areas that are not included within a triangle (i.e., the mesh will contain no "holes"). Typically, a set of 100 nodes (on a "386" machine with math coprocessor and EGA card) will require 10 seconds to generate the triangle mesh; a set of 400 nodes, 56 seconds; and 900 nodes, 165 seconds. The time devoted to contour line drawing (on the screen) is typically an additional 20-30 seconds. The contour lines are drawn as a series of connecting straight line segments and circular segments. This combination yields an aesthetically pleasing appearance to the resulting contour map.

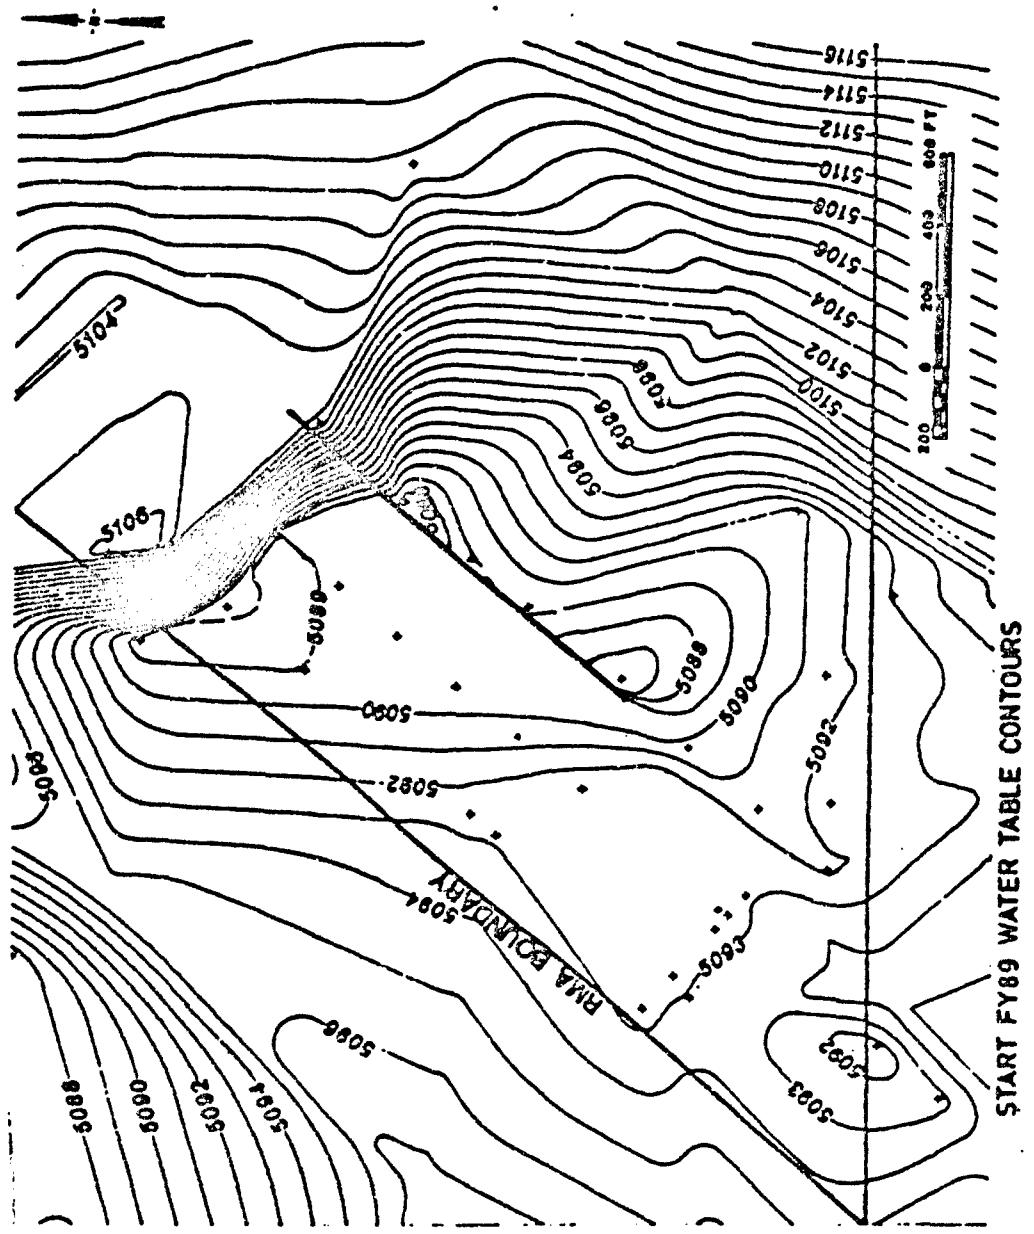


Figure 27. Water-table configuration (ft) at start of FY89

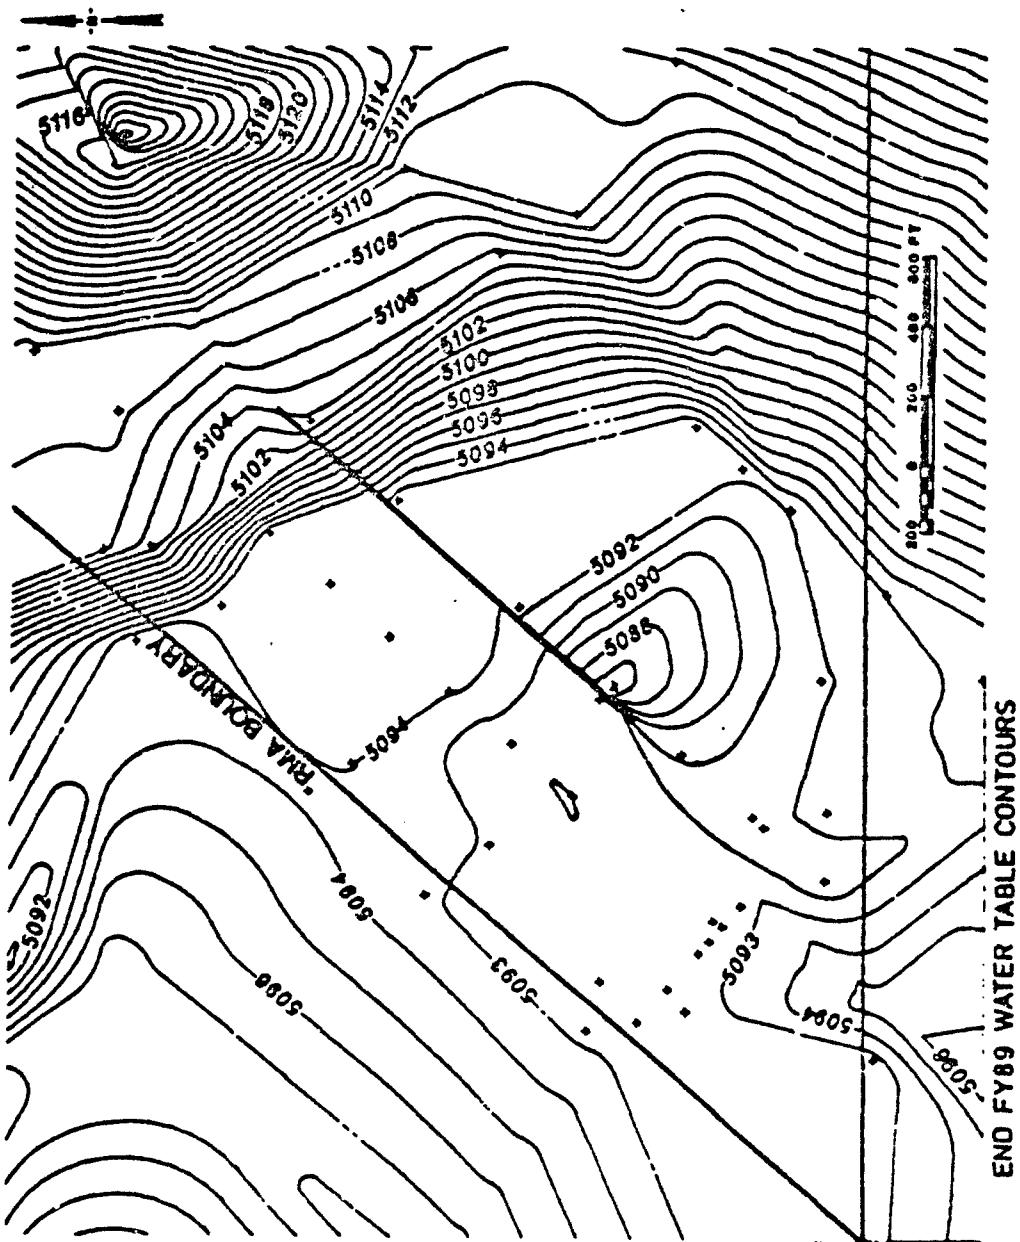


Figure 28. Water-table configuration (ft) at end of FY89

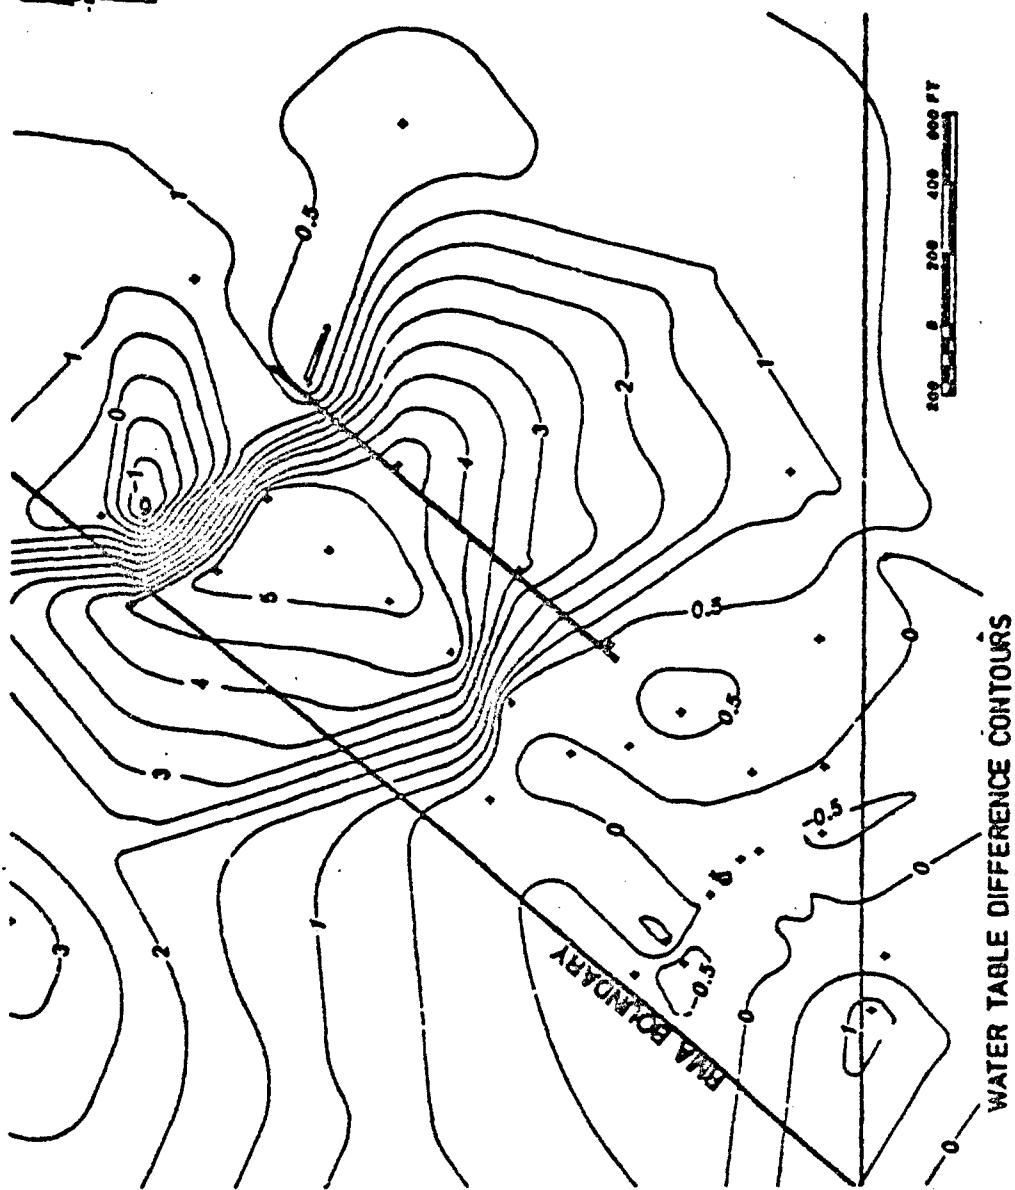


Figure 29. Water-table difference (ft) between start and end of FY89

rise of quarterly profiles among Figures 30 through 35. The rise was as great as 4 ft near the barrier as evident in Figures 34 and 35.

51. The rise in water table resulted from operational increases in flow rates and total flow to recharge wells at the northeast half of the system. This management action corrected a previously recognized condition of low water table immediately northwest of the barrier and associated unfavorable head gradient across the barrier. Contemporaneously, the water table rose substantially southeast of the barrier. The mounding of the water table resulting from the increased recharging impeded ground-water flow around the barrier and led to this buildup.

Denver Hydrogeology

52. Only a relatively few monitoring wells are screened in the Denver formation and these are further divided among at least three distinct aquifers. Accordingly no area-wide contouring of piezometric surfaces is meaningful as yet. A general parallelism between configurations in the Denver aquifers and in the alluvial aquifer has been established, but refinement must await the addition of more Denver monitoring wells.

Ground-water Hydrology

Long-Term Trend

53. Indications of a long-term decline in the water table were in accord with the decline indicated in the previous several years (TOD 1989). In Figure 31 the decline is evident among monitoring wells in Section 27 away from the influence of the NWBS. The range of levels for FY88 is shown for comparison. A similar decline is evident along profile 2 (Figure 32). The decline is not related to droughty conditions since annual precipitation has recently been above the average 15 in. as follows:

FY	Annual Precipitation (in.)
85	17.82
86	11.54
87	19.05
88	17.55
89	15.27

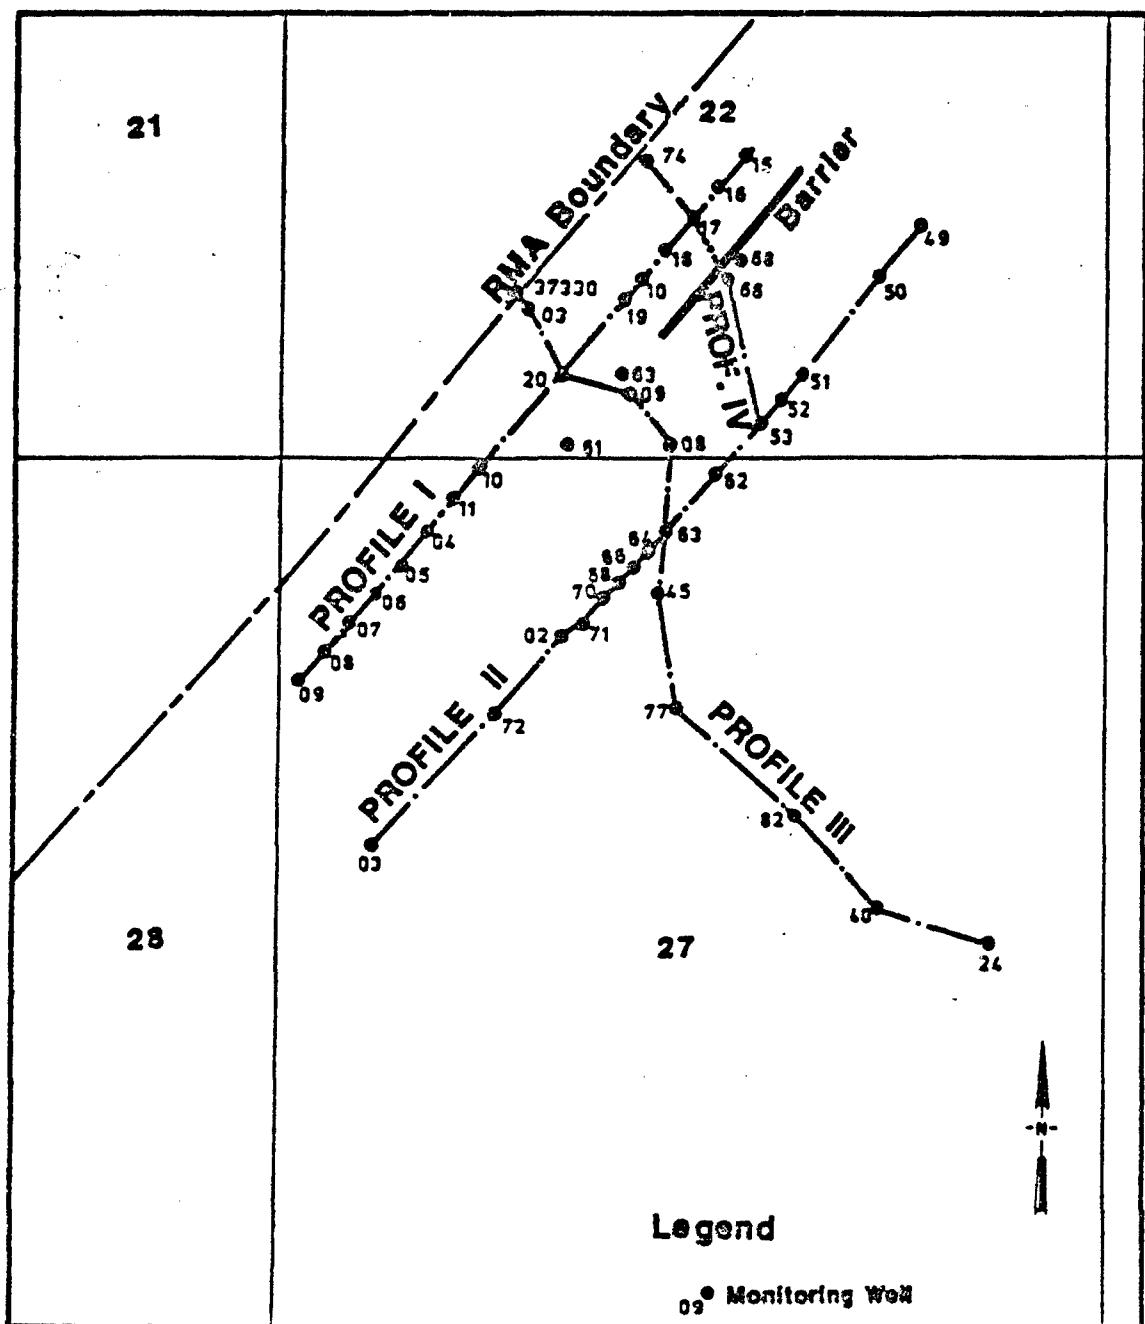


Figure 30. Locations of water-table profiles

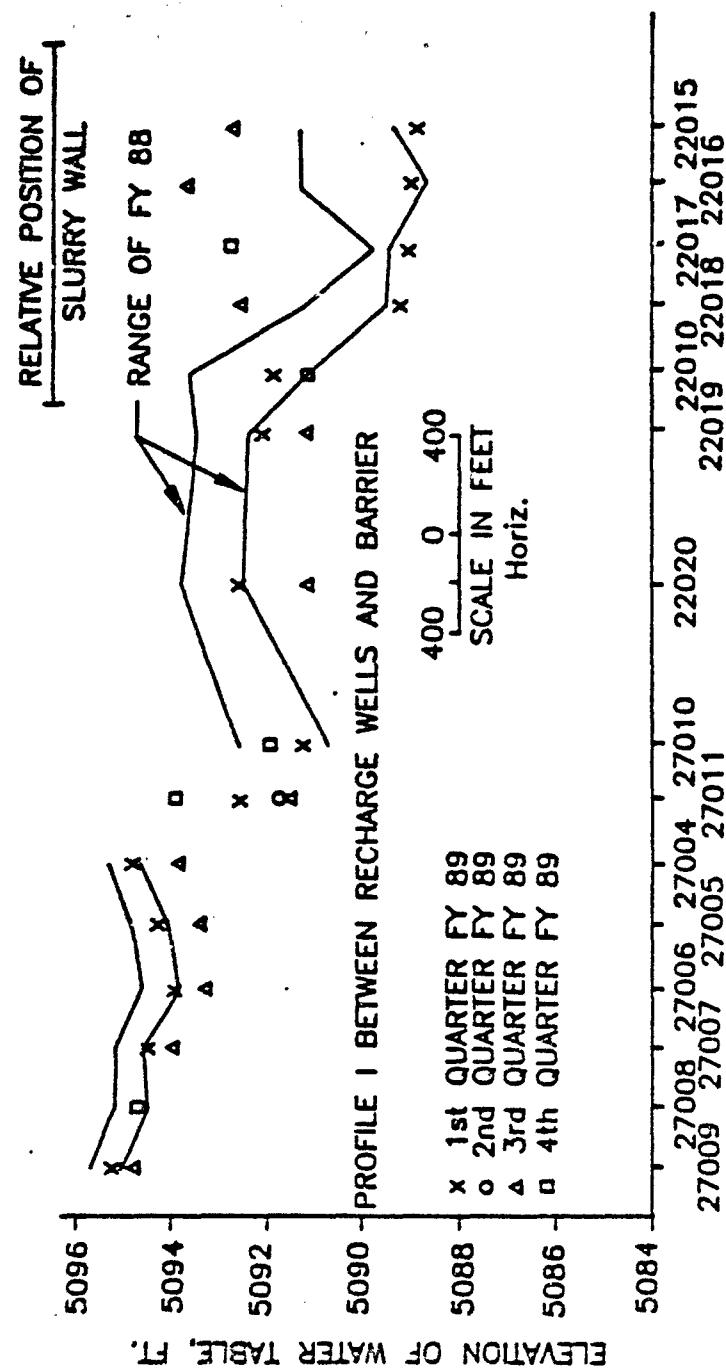


Figure 31. Profile I for FY 89

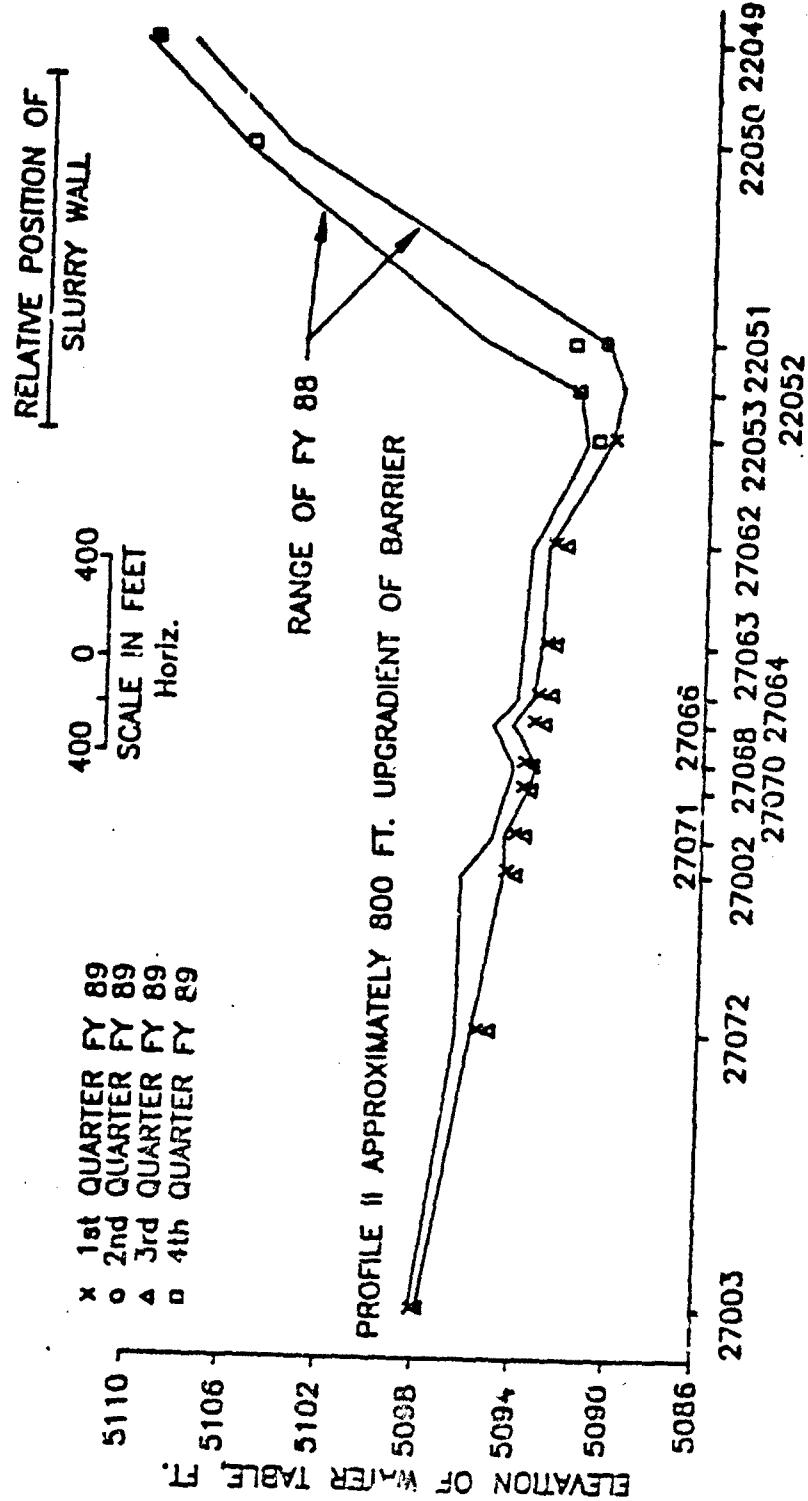


Figure 32. Profile II for FY 89

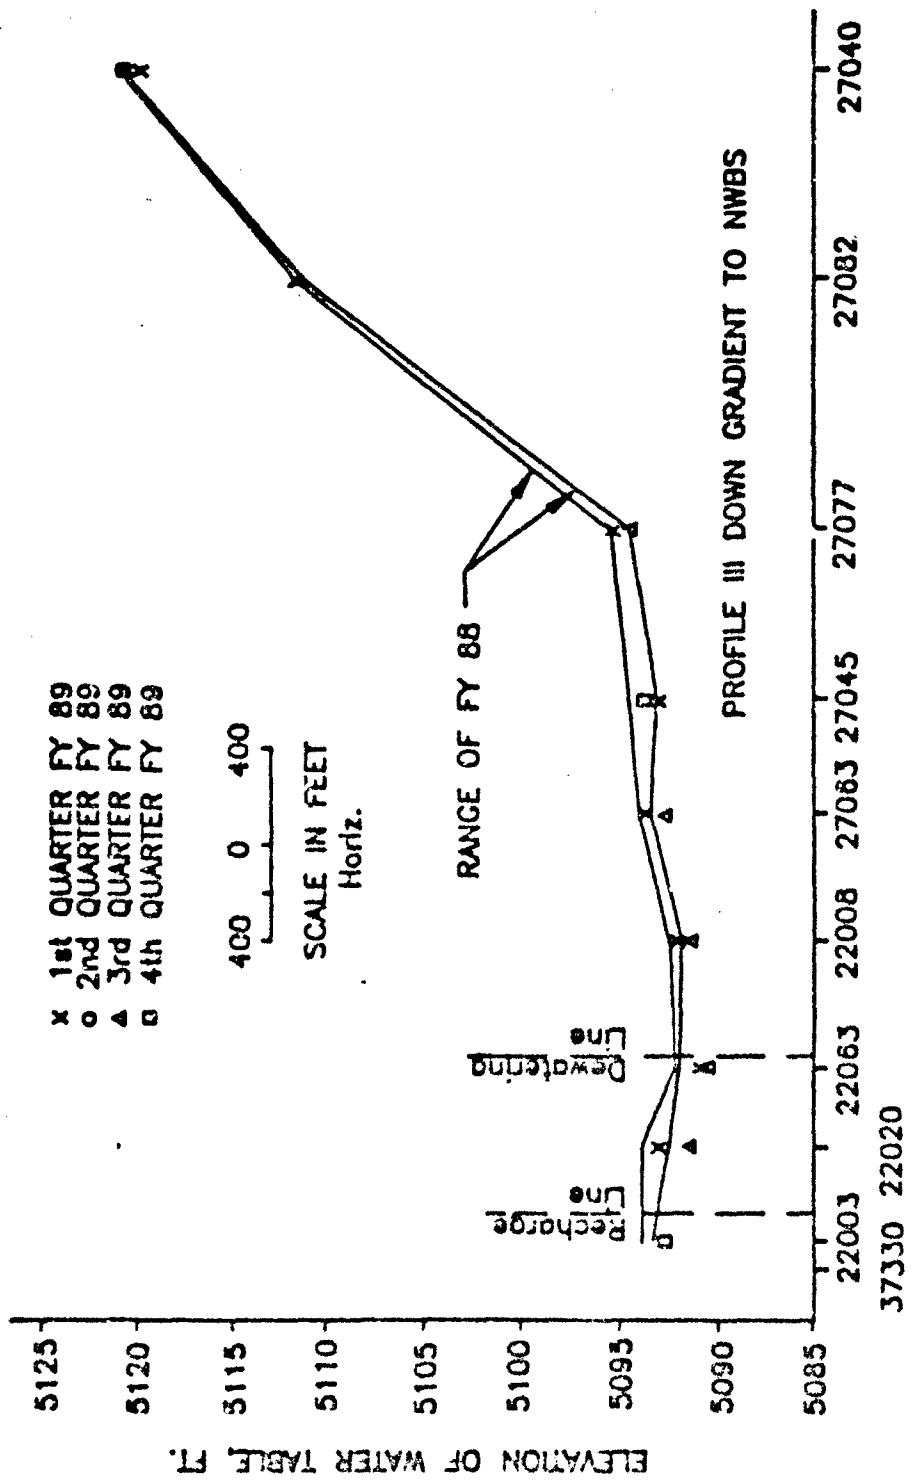


Figure 33. Profile III for FY 89

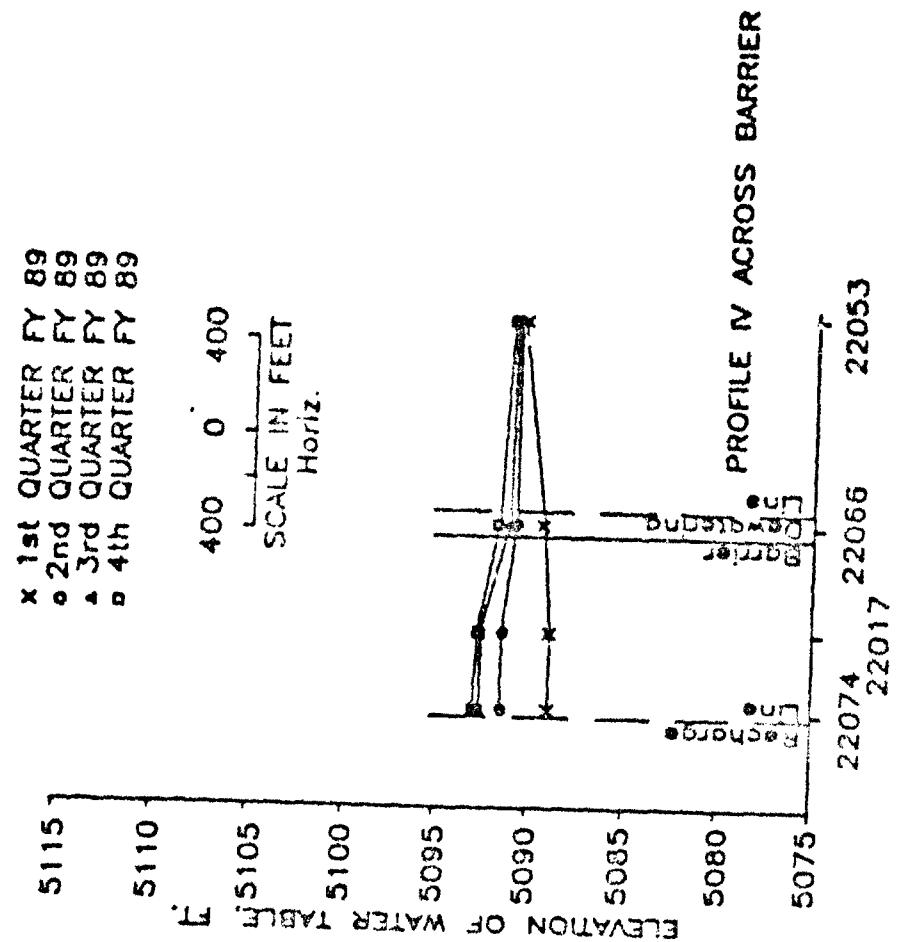


Figure 34. Profile IV for FY 89

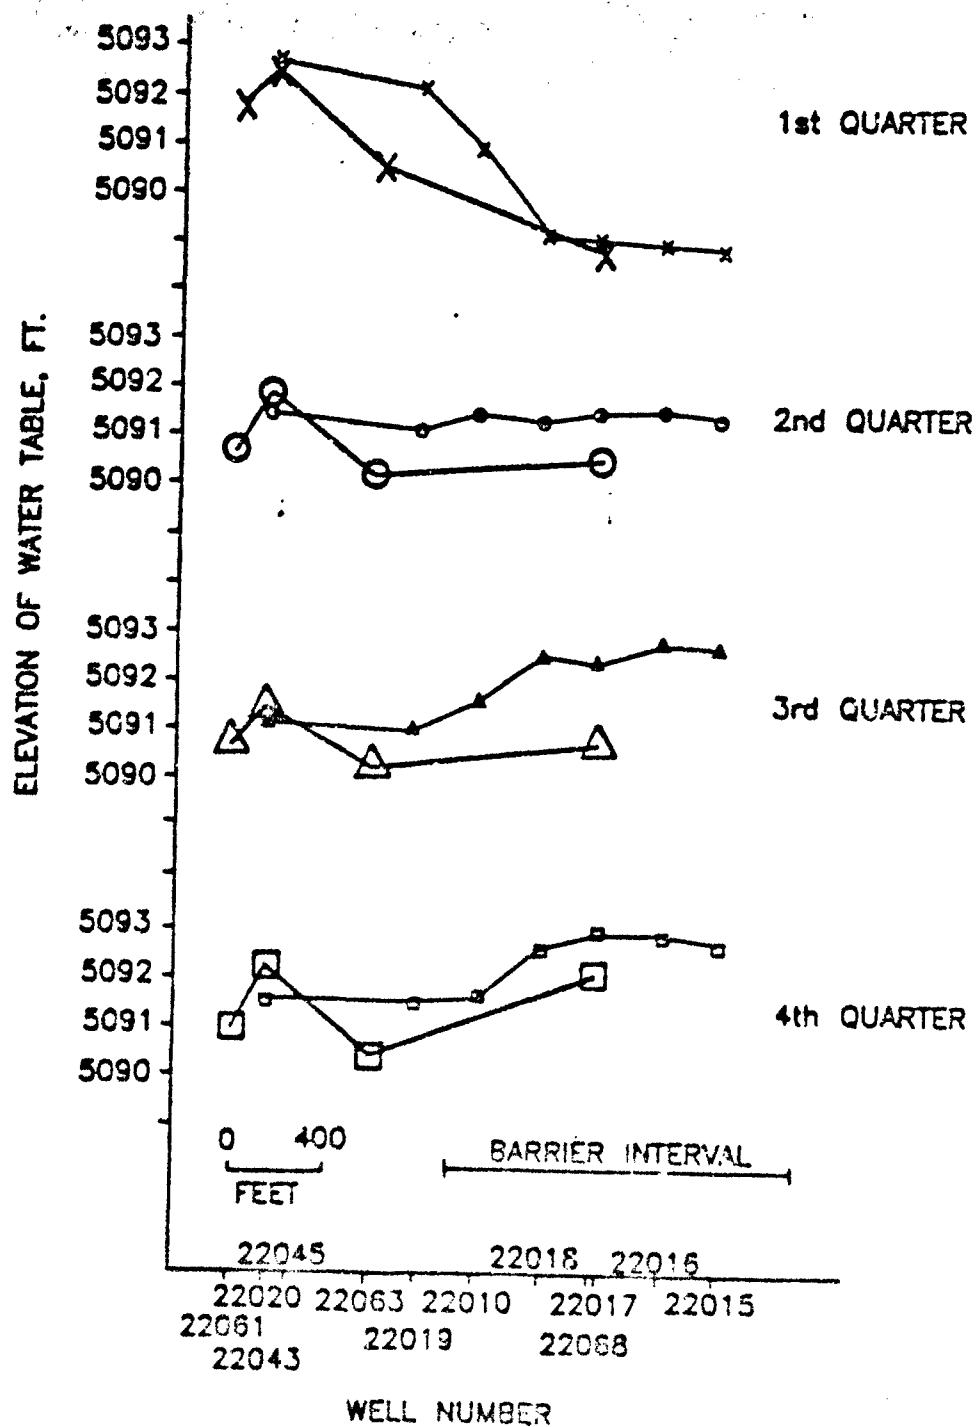


Figure 33. Comparison of ground-water levels on northwest side (light symbols) and southeast side (heavy symbols) of barrier

Seasonal Trend

54. Seasonal fluctuations are also evident in the behavior of the water table. Levels quarter by quarter are shown in Figures 31 through 33. Close examination reveals that the levels rose to a high in the first quarter, presumably with the onset of winter. Similarly, the low for the year came in the third quarter with the onset of the summer. This seasonal effect is best seen in Figure 32 but can also be found in Figures 31 and 33.

Recharge Function

55. The NWBS is considered to be operating most efficiently when there is a reverse water-table gradient southeastward. Figure 34 shows that a condition near neutral (neither northwest or southeast) was maintained throughout FY89. Figure 35 compares water-table conditions across the barrier from a different perspective. The water table in the profile northwest of the barrier from a different perspective. The water table in the profile northwest of the barrier alignment tended to be higher than along the parallel profile situated southeast of the barrier alignment.

PART V: CONCLUSIONS

56. Based on the evaluation of the FY89 operations data for the Northwest Boundary System, the following conditions can be made:

- a. Ground-water levels in the NWBS area were stable for FY89.
- b. An increased flow of recharge water was directed by management decision to the northeast end of the system to raise the water table.
- c. The desired neutral to southeastward gradient was maintained across the system throughout the year.
- d. The water table showed a small decline at locations away from the influence of the system.
- e. The treatment system in general effectively removed organic contaminants from the influent to the system. Chloroform was not as effectively removed by the treatment system as were the other organic contaminants monitored at the NWBS. Inorganic contaminants, such as chloride and fluoride, were not removed by the treatment system.

REFERENCES

Omaha District. 1986. "Construction Foundation Report; Northwest Boundary, RMA Containment/Treatment System," U.S. Army Engineer District, Omaha.

Program Manager Staff Office (PMSO). 1987. "Northwest Boundary Containment/Treatment System Baseline Conditions, System Startup and Operational Assessment Report for FY85/86," Rocky Mountain Arsenal Information Center Reference Library Number 88054R01, Rocky Mountain Arsenal, Commerce City, Colorado.

Program Manager for Rocky Mountain Arsenal (PMRMA). 1988. "Northwest Boundary Containment/Treatment System Operational Assessment Report, FY87, Final Report," Rocky Mountain Arsenal Information Center Reference Library Number 89263R02, Rocky Mountain Arsenal, Commerce City, Colorado.

Stollar and Associates. 1989. "Comprehensive Monitoring Program: Annual Ground Water Report for 1988 Final Report," Rocky Mountain Arsenal Information Center Library No. 89213R01, Rocky Mountain Arsenal, Commerce City, Colorado.

Program Manager for Rocky Mountain Arsenal (PMRMA). 1989. "Northeast Boundary Containment/Treatment System Operational Assessment, FY88," Final Report." Rocky Mountain Arsenal Information Center Reference Library No. 90061R02, Rocky Mountain Arsenal, Commerce city, Colorado.

APPENDIX A
FLOW DATA

A1

D.P.A.

NORTHWEST BOUNDARY TREATMENT PLANT
FY 89 WEEKLY FLOWS FOR ADSORBERS

DATE	1		2		3		TOTAL	
	GAL(00)	GPM	GAL(00)	GPM	GAL(00)	GPM	GAL(00)	GPM
10/07/88	0	0.00	3,918	388.69	3,000	297.62	6,918	686.31
10/14/88	0	0.00	3,936	390.28	3,260	323.25	7,196	713.53
10/21/88	0	0.00	3,973	394.54	3,192	316.98	7,165	711.52
10/28/88	0	0.00	4,002	396.63	3,162	313.38	7,164	710.01
11/04/88	0	0.00	3,552	350.64	3,018	297.93	6,570	648.57
11/11/88	0	0.00	3,585	357.78	3,179	317.27	6,764	675.05
11/18/88	0	0.00	3,584	352.93	3,258	320.83	6,842	673.76
11/25/88	0	0.00	3,557	353.05	3,093	306.00	6,640	659.05
12/02/88	0	0.00	3,188	316.11	2,948	292.32	6,136	608.43
12/09/88	0	0.00	3,544	351.24	2,731	270.66	6,275	621.90
12/16/88	0	0.00	3,672	364.47	2,717	269.68	6,389	634.15
12/23/88	0	0.00	3,614	358.89	2,484	246.67	6,098	605.56
12/30/88	0	0.00	3,672	363.38	2,513	248.69	6,185	612.07
01/06/89	0	0.00	3,541	352.16	2,399	238.59	5,940	590.75
01/13/89	0	0.00	3,551	351.34	2,700	267.14	6,251	618.48
01/20/89	0	0.00	3,520	349.62	2,299	228.35	5,819	577.97
01/27/89	0	0.00	3,496	347.17	2,064	204.97	5,560	552.14
02/03/89	0	0.00	3,486	345.32	2,194	217.34	5,680	562.66
02/10/89	0	0.00	2,998	298.31	2,449	243.68	5,447	541.99
02/17/89	916	90.87	2,003	198.71	3,124	309.92	6,043	599.50
02/24/89	3,711	367.97	0	0.00	3,989	296.38	6,700	664.35
03/03/89	3,805	377.11	0	0.00	2,973	294.65	6,778	671.76
03/10/89	3,636	361.25	0	0.00	2,908	288.92	6,544	650.17
03/17/89	3,525	349.36	0	0.00	3,027	300.00	6,552	649.36
03/24/89	3,522	349.06	0	0.00	2,856	283.05	6,378	632.11
03/31/89	3,849	380.71	0	0.00	2,897	286.55	6,746	667.26
04/07/89	3,472	344.27	0	0.00	3,143	311.65	6,615	655.92
04/14/89	3,206	321.73	0	0.00	3,672	368.49	6,878	690.22
04/21/89	3,231	320.38	0	0.00	3,879	384.63	7,110	705.01
04/28/89	3,337	331.22	0	0.00	3,698	367.05	7,035	698.27
05/05/89	3,498	346.34	0	0.00	3,452	341.78	6,950	688.12
05/12/89	3,604	358.25	0	0.00	3,120	310.14	6,724	668.39
05/19/89	3,462	342.77	0	0.00	3,211	317.92	6,673	660.69
05/26/89	3,274	325.45	0	0.00	3,334	331.41	6,608	656.86
06/02/89	3,366	333.93	0	0.00	3,244	321.83	6,610	655.76
06/09/89	3,177	315.18	0	0.00	3,370	334.33	6,547	649.51
06/16/89	3,317	329.07	0	0.00	3,508	348.02	6,825	677.09
06/23/89	3,523	348.64	0	0.00	3,226	319.25	6,749	667.89
06/30/89	3,477	345.80	0	0.00	3,103	308.60	6,580	654.40
07/07/89	3,301	326.51	0	0.00	2,953	292.09	6,254	618.60
07/14/89	3,607	354.32	0	0.00	2,347	230.55	5,954	584.87
07/21/89	3,470	348.74	0	0.00	2,628	264.12	6,098	612.86
07/28/89	3,537	350.20	0	0.00	2,773	274.55	6,310	624.75

B.P.A.

NORTHWEST BOUNDARY TREATMENT PLANT
FY 89 WEEKLY FLOWS FOR ADSORBERS

DATE	1		2		3		TOTAL	
	GAL(00)	GPM	GAL(00)	GPM	GAL(00)	GPM	GAL(00)	GPM
08/04/89	3,646	362.25	0	0.00	2,946	292.70	6,592	654.95
08/11/89	3,542	351.39	0	0.00	2,364	234.52	5,906	585.91
08/18/89	3,486	346.00	0	0.00	2,310	229.28	5,796	575.28
08/25/89	3,137	310.59	634	62.77	1,696	167.92	5,467	541.28
09/01/89	3,783	375.86	324	32.19	1,760	174.86	5,867	582.91
09/08/89	3,582	355.53	2,591	257.17	0	0.00	6,173	612.70
09/15/89	3,118	309.33	2,490	247.02	0	0.00	5,608	556.35
09/22/89	3,473	344.37	2,953	292.81	0	0.00	6,426	637.18
09/30/89	4,090	355.19	3,343	290.32	0	0.00	7,433	645.51

D.P.A.

NORTHWEST BOUNDARY TREATMENT PLANT
FY 89 QUARTERLY FLOWS FOR ADSORBERS

DATE	1		2		3		TOTAL	
	GAL(00)	GPM	GAL(00)	GPM	GAL(00)	GPM	GAL(00)	GPM
1st QTR	0	0.00	47,797	364.51	38,545	293.94	86,342	658.45
2nd QTR	22,964	175.10	22,595	172.51	34,879	266.12	80,438	613.73
3rd QTR	43,944	335.62	0	0.00	43,960	335.78	87,904	671.39
4th QTR	45,772	345.41	12,335	90.94	21,777	166.20	79,884	602.55
ANNUAL	112,680	214.03	82,727	156.99	139,161	265.51	334,568	636.53

APPENDIX B
TREATMENT PLANT WATER QUALITY DATA STATISTICAL SUMMARY
AND GC/MS ANALYSIS

NORTHWEST BOUNDARY TREATMENT PLANT - INFILUENT FOR FY 89

SAMPLE DATE	111TCE ug/l	112TCE ug/l	110CB ug/l	110CLE ug/l	120CE ug/l	120CLE ug/l	130MB ug/l	ALDRN ug/l	AS ug/l
10/06/88	LT 0.050
10/13/88	LT 0.050
10/20/88
10/27/88	LT 0.050
11/03/88	LT 0.050
11/10/88	LT 0.050
11/17/88	LT 0.050
11/24/88
12/01/88	LT 0.050
12/08/88	LT 0.050
12/15/88	0.107
12/22/88	LT 0.050
12/29/88
01/04/89	LT 0.050
01/11/89	LT 0.050
01/18/89	LT 0.760	LT 0.780	LT 1.700	LT 0.730	LT 0.760	LT 1.100	LT 1.320	LT 0.050	LT 2.350
01/25/89	LT 0.050
02/01/89	LT 0.050
02/08/89	LT 0.050
02/15/89	LT 0.050
02/22/89
03/01/89	LT 0.050
03/08/89	LT 0.050
03/15/89	0.058
03/22/89	LT 0.050
03/29/89	LT 0.050
04/05/89	LT 0.050
04/12/89	LT 0.050
04/19/89	LT 0.050
04/26/89	LT 0.050
05/03/89	LT 0.050
05/10/89	LT 0.050
05/17/89	LT 0.050
05/24/89	LT 0.050
05/31/89	LT 0.050
06/07/89	LT 0.050
06/14/89	LT 0.050
06/21/89	LT 0.760	LT 0.780	LT 1.700	LT 0.730	LT 0.760	LT 1.100	LT 1.320	LT 0.050	LT 2.350
06/28/89	LT 0.050
07/05/89	LT 0.050
07/12/89	LT 0.050
07/19/89	LT 0.050
07/26/89	LT 0.050
08/02/89	LT 0.050
08/09/89
08/16/89	LT 0.050
08/23/89	LT 0.050
08/30/89	LT 0.050
09/06/89	LT 0.050
09/13/89	LT 0.050
09/20/89	LT 0.050
09/27/89	LT 0.050

LT = LESS THAN The Following Concentration

ug/l = MICROGRAM PER LITER

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

mg/l = MILLIGRAM PER LITER

NORTHWEST SEWERAGE TREATMENT PLANT - INFILTRANT FEB 1989

SAMPLE DATE	AT2 ug/l	BCPPO ug/l	BT2 ug/l	CB46 ug/l	CL4 ug/l	CH2CL2 ug/l	CHCl3 ug/l	CHLORIDE mg/l	CHClP ug/l
10/06/88	330
10/13/88
10/20/88	310
10/27/88	330
11/03/88	290
11/10/88	330
11/17/88	320
11/24/88
12/01/88	310
12/08/88	310
12/15/88	260
12/22/88	270
12/29/88
01/04/89	270
01/11/89	250
01/12/89	LT 4.030	LT 5.000	LT 1.050	LT 0.990	LT 7.400	21.650	257	LT 0.048
01/25/89	290
02/01/89	260
02/08/89	240
02/15/89	240
02/22/89	240
03/01/89	240
03/08/89	250
03/15/89	240
03/22/89	240
03/29/89	240
04/05/89	240
04/12/89	230
04/19/89	240
04/26/89	240
05/03/89	230
05/10/89	280
05/17/89	240
05/24/89	260
05/31/89	230
06/07/89	210
06/14/89	230
06/21/89	LT 5.900	LT 5.000	LT 1.050	LT 0.990	LT 7.400	47.300	267	LT 0.048
06/28/89	300
07/05/89	360
07/12/89	290
07/19/89	240
07/26/89	270
08/02/89	230
08/09/89	260
08/16/89	220
08/23/89	190
08/30/89	290
09/06/89	270
09/13/89	260
09/20/89	280
09/27/89	310

LT = LESS THAN The Following Concentration

ug/l = MICROGRAM PER LITER

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

mg/l = MILLIGRAM PER LITER

NORTHWEST BOUNDARY TREATMENT PLANT - INFLUENT FOR FY 89

SAMPLE DATE	CCLCNS ug/l	CLDAN ug/l	CPMS ug/l	CPMSO ug/l	CPMSO2 ug/l	DCP ug/l	DCPO ug/l	DOVP ug/l	DIMP ug/l
10/06/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	3.550
10/13/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	3.430
10/20/88	LT 5.690	LT 11.500	LT 7.460	LT 5.000
10/27/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.660
11/03/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.660
11/10/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.570
11/17/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.610
11/24/88
12/01/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.620
12/08/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.140
12/15/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.350
12/22/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.260
12/29/88
01/04/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.360
01/11/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.040
01/18/89	LT 0.829	LT 0.095	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	LT 0.384	3.160
01/25/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.950
02/01/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.280
02/08/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.010
02/15/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.470
02/22/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.620
03/01/89	LT 5.000	2.840
03/08/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.630
03/15/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.460
03/22/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	2.730
03/29/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.780
04/05/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.570
04/12/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.740
04/19/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.960
04/26/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.190
05/03/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.540
05/10/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.525
05/17/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.230
05/24/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.640
05/31/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.280
06/07/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.140
06/14/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.340
06/21/89	LT 0.820	LT 0.095	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.573
06/28/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.590
07/05/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.010
07/12/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.920
07/19/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	860
07/26/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.220
08/02/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.990
08/09/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.220
08/16/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.600
08/23/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.010
08/30/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.040
09/06/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.410
09/13/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.000
09/20/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	1.270
09/27/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000

LT = LESS THAN The Following Concentration INDICATES THAT ANALYSIS WAS NOT PERFORMED
 ug/l = MICROGRAM PER LITER mg/l = MILLIGRAM PER LITER

WESTAR ENERGY TREATMENT PLANT - INFLUENT FOR FY 89

SAMPLE DATE	CITRUS	SDSAB	SDSOS	SDSOH	SDTCAB	FLUORIDE	ISOCOB	MECHAB	MILTRIN
	ug/l	ug/l	ug/l	ug/l	ug/l	ug/l	ug/l	ug/l	ug/l
10/26/88	LT	1.340	0.326	LT 0.050	2.910	LT 0.051
10/13/88	LT	1.340	0.318	LT 0.050	LT 0.051
10/20/88	LT	1.340	2.310
10/27/88	LT	1.340	0.282	LT 0.050	2.550	LT 0.051
11/03/88	LT	1.340	0.278	LT 0.050	2.471	LT 0.051
11/10/88	LT	1.340	0.288	LT 0.050	2.510	LT 0.051
11/17/88	LT	1.340	0.346	LT 0.050	2.720	LT 0.051
11/24/88
12/01/88	LT	1.340	0.086	0.046	2.670	0.085
12/08/88	LT	1.340	0.417	LT 0.050	2.830	0.086
12/15/88	LT	1.340	0.454	LT 0.050	2.440	0.077
12/22/88	LT	1.340	0.377	LT 0.050	2.270	LT 0.051
12/29/88
01/06/89	LT	1.340	0.371	LT 0.050	2.300	LT 0.051
01/11/89	LT	1.340	0.433	LT 0.050	2.200	LT 0.051
01/18/89	LT	1.340	0.405	LT 0.950	LT 0.050	LT 1.370	2.143	LT 0.051	LT 1.470
01/25/89	LT	1.340	0.437	LT 0.050	2.270	0.063
02/01/89	LT	1.340	0.496	LT 0.050	2.240	LT 0.051
02/08/89	LT	1.340	0.495	LT 0.050	1.980	LT 0.051
02/15/89	LT	1.340	0.516	LT 0.050	2.240	LT 0.051
02/22/89	LT	1.340	2.070
03/01/89	0.368	LT 0.050	2.050	LT 0.051
03/08/89	LT	1.340	0.367	LT 0.050	2.220	LT 0.051
03/15/89	LT	1.340	0.412	LT 0.050	2.070	LT 0.051
03/22/89	LT	1.340	0.417	LT 0.050	1.910	LT 0.051
03/29/89	LT	1.340	0.364	LT 0.050	1.920	LT 0.051
04/05/89	LT	1.340	0.375	LT 0.050	1.920	0.072
04/12/89	LT	1.340	0.469	LT 0.050	1.800	LT 0.051
04/19/89	LT	1.340	LT 0.050	LT 0.050	1.830	LT 0.051
04/26/89	LT	1.340	LT 0.050	LT 0.050	1.860	LT 0.051
05/03/89	LT	1.340	0.431	LT 0.050	1.710	LT 0.051
05/10/89	LT	1.340	0.431	LT 0.050	1.973	LT 0.051
05/17/89	LT	1.340	0.418	LT 0.050	1.750	LT 0.051
05/24/89	LT	1.340	0.390	LT 0.050	1.780	LT 0.051
05/31/89	LT	1.340	0.419	LT 0.050	1.950	LT 0.051
06/07/89	LT	1.340	0.379	LT 0.050	1.340	LT 0.051
06/14/89	LT	1.340	0.403	LT 0.050	1.610	LT 0.051
06/21/89	LT	1.340	0.451	LT 0.405	LT 0.050	LT 1.370	2.017	LT 0.051	LT 1.470
06/28/89	LT	1.340	0.372	LT 0.050	2.250	LT 0.051
07/05/89	LT	1.340	0.439	LT 0.050	2.700	LT 0.051
07/12/89	LT	1.340	0.514	LT 0.050	2.480	LT 0.051
07/19/89	LT	1.340	0.537	LT 0.050	2.220	LT 0.051
07/26/89	LT	1.340	0.447	LT 0.050	2.080	LT 0.051
08/02/89	LT	1.340	0.422	LT 0.050	2.110	LT 0.051
08/09/89	LT	1.340	0.424	LT 0.050	2.140	LT 0.051
08/16/89	LT	1.340	0.505	LT 0.050	2.110	LT 0.051
08/23/89	LT	1.340	0.444	LT 0.050	2.060	LT 0.051
08/30/89	LT	1.340	0.458	LT 0.050	2.070	LT 0.051
09/06/89	LT	1.340	0.444	LT 0.050	2.000	LT 0.051
09/13/89	LT	1.340	0.238	LT 0.050	1.980	LT 0.051
09/20/89	LT	1.340	0.442	LT 0.050	2.050	LT 0.051
09/27/89	LT	1.340	0.449	LT 0.050	2.300	LT 0.051

LT = LESS THAN THE Following Concentration

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

ug/l = MICROGRAM PER LITER

mg/l = MILLIGRAM PER LITER

NORTHWEST BOUNDARY TREATMENT PLANT - INFLUENT FOR FY 89

SAMPLE DATE	OXAT ug/l	PPDDE ug/l	PPDDE ug/l	PHTOX ug/l	SO4 ug/l	SUPOMA ug/l	TCLEE ug/l	TCLE ug/l	XYLEN ug/l
10/06/88	LT 2.380	LT 0.560
10/13/88	LT 2.380	LT 0.560
10/20/88	LT 2.380
10/27/88	LT 2.380	LT 0.560
11/03/88	LT 2.380	LT 0.560
11/10/88	LT 2.380	LT 0.560
11/17/88	LT 2.380	LT 0.560
11/24/88	LT 0.560
12/01/88	LT 2.380	LT 0.560
12/08/88	LT 2.380	LT 0.560
12/15/88	LT 2.380	LT 0.560
12/22/88	LT 2.380	LT 0.560
12/29/88	LT 0.560
01/04/89	LT 2.380	LT 0.560
01/11/89	LT 2.380	LT 0.560
01/18/89	LT 2.380	LT 0.054	LT 0.049	LT 0.647	130	LT 0.769	LT 0.560	LT 1.360
01/25/89	LT 2.380	LT 0.560
02/01/89	LT 2.380	LT 0.560
02/08/89	LT 2.380	LT 0.560
02/15/89	LT 2.380	LT 0.560
02/22/89	LT 2.380	LT 0.560
03/01/89	LT 0.560
03/08/89	LT 2.380	LT 0.560
03/15/89	LT 2.380	LT 0.560
03/22/89	LT 2.380	LT 0.560
03/29/89	LT 2.380	LT 0.560
04/05/89	LT 2.380	LT 0.560
04/12/89	LT 2.380	LT 0.560
04/19/89	LT 2.380	LT 0.560
04/26/89	LT 2.380	LT 0.560
05/03/89	LT 2.380	LT 0.560
05/10/89	LT 2.380	LT 0.560
05/17/89	LT 2.380	LT 0.560
05/24/89	LT 2.380	LT 0.560
05/31/89	LT 2.380	LT 0.560
06/07/89	LT 2.380	LT 0.560
06/14/89	LT 2.380	LT 0.560
06/21/89	LT 2.380	LT 0.054	LT 0.049	1.765	140	LT 0.750	0.668	LT 1.360
06/28/89	LT 2.380	LT 0.560
07/03/89	LT 2.380	LT 0.560
07/10/89	LT 2.380	LT 0.360
07/17/89	LT 2.380	LT 0.560
07/24/89	LT 2.380	LT 0.360
08/02/89	LT 2.380	LT 0.360
08/09/89	LT 2.380	LT 0.560
08/16/89	LT 2.380	LT 0.560
08/23/89	LT 2.380	LT 0.560
08/30/89	LT 2.380	LT 0.560
09/06/89	LT 2.380	LT 0.560
09/13/89	LT 2.380	LT 0.560
09/20/89	LT 2.380	LT 0.560
09/27/89	LT 2.380	LT 0.560

LT = LESS THAN The Following Concentration
ug/l = MICROGRAM PER LITER

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED
mg/l = MILLIGRAM PER LITER

MONTGOMERY WASTEWATER TREATMENT PLANT - EFFLUENT POX PT 99

SAMPLE DATE	111TCB ug/l	112TCB ug/l	113CB ug/l	114CBL ug/l	122CB ug/l	123CBL ug/l	130MB ug/l	ALDEN ug/l	AS ug/l
10/06/89	LT 0.050
10/13/89	LT 0.050
10/20/89
10/27/89	LT 0.050
11/03/89	LT 0.050
11/10/89	LT 0.050
11/17/89	LT 0.050
11/24/89
12/01/89	LT 0.050
12/08/89	LT 0.050
12/15/89	0.116
12/22/89	LT 0.050
12/29/89
01/06/89	LT 0.050
01/11/89	LT 0.050
01/18/89	LT 0.760	LT 0.780	LT 1.700	LT 0.730	LT 0.760	LT 1.100	LT 1.320	LT 0.050	LT 2.350
01/25/89	LT 0.050
02/01/89	LT 0.050
02/08/89	0.073
02/15/89	LT 0.050
02/22/89
03/01/89	LT 0.050
03/08/89	LT 0.050
03/15/89	LT 0.050
03/22/89	LT 0.050
03/29/89	LT 0.050
04/05/89	LT 0.050
04/12/89	LT 0.050
04/19/89	0.081
04/26/89	LT 0.050
05/03/89	LT 0.050
05/10/89	LT 0.050
05/17/89	LT 0.050
05/24/89	LT 0.050
05/31/89	LT 0.050
06/07/89	LT 0.050
06/14/89	LT 0.050
06/21/89	LT 0.760	LT 0.780	LT 1.700	LT 0.730	LT 0.760	LT 1.100	LT 1.320	LT 0.050	LT 2.350
06/28/89	LT 0.050
07/05/89	LT 0.050
07/12/89	LT 0.050
07/19/89	LT 0.050
07/26/89	LT 0.050
08/02/89	LT 0.050
08/09/89
08/16/89	LT 0.050
08/23/89	LT 0.050
08/30/89	LT 0.050
09/06/89	LT 0.050
09/13/89	LT 0.050
09/20/89	LT 0.050
09/27/89	LT 0.050

LT = LESS THAN The following Concentration

ug/l = MICROGRAM PER LITER

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

ug/l = MILLIGRAM PER LITER

NORTHWEST BOUNDARY TREATMENT PLANT - EFFLUENT FOR FY 89

SAMPLE DATE	AT2 ug/l	BCPDS ug/l	BTZ ug/l	C6H6 ug/l	CCl4 ug/l	CH2Cl2 ug/l	CHCl3 ug/l	CHLORIDE mg/l	CL6CP ug/l
10/06/88	330
10/13/88
10/20/88	300
10/27/88	330
11/03/88	290
11/10/88	300
11/17/88	320
11/24/88
12/01/88	300
12/08/88	310
12/15/88	270
12/22/88	270
12/29/88
01/04/89	270
01/11/89	250
01/18/89	LT 4.030	LT 5.000	LT 1.050	LT 0.990	LT 7.400	23.500	250	LT 0.048
01/25/89	270
02/01/89	260
02/08/89	230
02/15/89	250
02/22/89	240
03/01/89	240
03/08/89	250
03/15/89	230
03/22/89	240
03/29/89	240
04/05/89	240
04/12/89	230
04/19/89	240
04/26/89	230
05/03/89	230
05/10/89	270
05/17/89	240
05/24/89	250
05/31/89	230
06/07/89	200
06/14/89	210
06/21/89	LT 5.900	LT 5.000	LT 1.050	LT 0.990	LT 7.400	19.700	265	LT 0.048
06/28/89	300
07/05/89	350
07/12/89	280
07/19/89	240
07/26/89	250
08/02/89	240
08/09/89	230
08/16/89	220
08/23/89	230
08/30/89	270
09/06/89	260
09/13/89	260
09/20/89	280
09/27/89	330

LT = LESS THAN The Following Concentration

ug/l = MICROGRAM PER LITER

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

mg/l = MILLICRAM PER LITER

MONTGOMERY BOUNDARY TREATMENT PLANT - EFFLUENT FOR FY 89

SAMPLE DATE	CLC635 ug/l	C13AN ug/l	CPMS ug/l	CPMSO ug/l	CPMSO2 ug/l	DSCP ug/l	DCPO ug/l	DCVP ug/l	DIMP ug/l
10/09/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	4.310
10/13/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	5.080
10/20/88	LT 5.690	LT 11.500	LT 7.460	LT 5.000
10/27/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.410
11/03/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.990
11/10/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.180
11/17/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.590
11/24/88
12/01/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.490
12/08/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.390
12/15/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.610
12/22/88	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.490
12/29/88
01/05/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.260
01/12/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.590
01/19/89	LT 0.820	LT 0.095	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	LT 0.384	3.770
01/26/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.510
02/02/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.820
02/09/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.470
02/16/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.740
02/23/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.760
03/01/89	LT 5.000	3.350
03/08/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.650
03/15/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.360
03/22/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	3.850
03/29/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.660
04/05/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.190
04/12/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.900
04/19/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.770
04/26/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.470
05/03/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.240
05/10/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.970
05/17/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.360
05/24/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.450
05/31/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.630
06/07/89	LT 0.195	LT 5.000	4.460
06/14/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.200
06/21/89	LT 0.820	LT 0.095	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.710
06/28/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.760
07/05/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.090
07/12/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	5.390
07/19/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	830
07/26/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.310
08/02/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	2.550
08/09/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.950
08/16/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.840
08/23/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.890
08/30/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.360
09/06/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	4.150
09/13/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000	3.910
09/20/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	3.160
09/27/89	LT 5.690	LT 11.500	LT 7.460	LT 0.195	LT 5.000

LT = LESS THAN The Following Concentration

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

ug/l = MICROGRAM PER LITER

mg/l = MILLIGRAM PER LITER

NORTHWEST BOUNDARY TREATMENT PLANT - EFFLUENT FOR FY 89

SAMPLE DATE	DITH ug/l	OLDRN ug/l	DROS ug/l	ENDRN ug/l	ETC6NS ug/l	FLUORIDE mg/l	ISODR ug/l	MECANS ug/l	MLTHM ug/l
10/06/88	LT 1.340	LT 0.050	LT 0.050	2.550	LT 0.051
10/13/88	LT 1.340	LT 0.050	LT 0.050	LT 0.051
10/20/88	LT 1.340	2.300
10/27/88	LT 1.340	LT 0.050	LT 0.050	2.600	LT 0.051
11/03/88	LT 1.340	LT 0.050	LT 0.050	2.480	LT 0.051
11/10/88	LT 1.340	LT 0.050	LT 0.050	2.530	LT 0.051
11/17/88	LT 1.340	LT 0.050	LT 0.050	2.650	LT 0.051
11/24/88
12/01/88	LT 1.340	LT 0.050	LT 0.050	2.680	LT 0.051
12/08/88	LT 1.340	LT 0.050	LT 0.050	2.720	LT 0.051
12/15/88	LT 1.340	LT 0.050	LT 0.050	2.480	LT 0.051
12/22/88	LT 1.340	LT 0.050	LT 0.050	2.310	LT 0.051
12/29/88
01/04/89	LT 1.340	LT 0.050	LT 0.050	2.320	LT 0.051
01/11/89	LT 1.340	LT 0.050	LT 0.050	2.380	LT 0.051
01/18/89	LT 1.340	LT 0.050	LT 0.550	LT 0.050	LT 1.370	2.185	LT 0.051	LT 1.470	90,000
01/25/89	LT 1.340	LT 0.050	LT 0.050	2.210	LT 0.051
02/01/89	LT 1.340	LT 0.050	LT 0.050	2.260	LT 0.051
02/08/89	LT 1.340	LT 0.050	LT 0.050	2.050	LT 0.051
02/15/89	LT 1.340	LT 0.050	LT 0.050	2.200	LT 0.051
02/22/89	LT 1.340	2.090
03/01/89	LT 0.050	LT 0.050	2.090	LT 0.051
03/08/89	LT 1.340	LT 0.050	LT 0.050	2.190	LT 0.051
03/15/89	LT 1.340	LT 0.050	LT 0.050	1.970	LT 0.051
03/22/89	LT 1.340	LT 0.050	LT 0.050	1.930	LT 0.051
03/29/89	LT 1.340	LT 0.050	LT 0.050	1.910	LT 0.051
04/05/89	LT 1.340	LT 0.050	LT 0.050	1.910	LT 0.051
04/12/89	LT 1.340	LT 0.050	LT 0.050	1.840	LT 0.051
04/19/89	LT 1.340	LT 0.050	LT 0.050	1.790	LT 0.051
04/26/89	LT 1.340	0.192	LT 0.050	1.910	LT 0.051
05/03/89	LT 1.340	LT 0.050	LT 0.050	1.700	LT 0.051
05/10/89	LT 1.340	LT 0.050	LT 0.050	2.030	LT 0.051
05/17/89	LT 1.340	LT 0.050	LT 0.050	1.730	LT 0.051
05/24/89	LT 1.340	LT 0.050	LT 0.050	1.680	LT 0.051
05/31/89	LT 1.340	LT 0.050	LT 0.050	1.570	LT 0.051
06/07/89	LT 0.050	LT 0.050	1.390	LT 0.051
06/14/89	LT 1.340	LT 0.050	LT 0.050	1.430	LT 0.051
06/21/89	LT 1.340	LT 0.050	LT 0.429	LT 0.050	LT 1.370	2.055	LT 0.051	LT 1.470
06/28/89	LT 1.340	LT 0.050	LT 0.050	2.250	LT 0.051
07/03/89	LT 1.340	LT 0.050	LT 0.050	2.630	LT 0.051
07/12/89	LT 1.340	LT 0.050	LT 0.050	2.420	LT 0.051
07/19/89	LT 1.340	LT 0.050	LT 0.050	2.140	LT 0.051
07/26/89	LT 1.340	LT 0.050	LT 0.050	2.100	LT 0.051
08/02/89	LT 1.340	LT 0.050	LT 0.050	2.190	LT 0.051
08/09/89	LT 1.340	LT 0.050	LT 0.050	2.110	LT 0.051
08/16/89	LT 1.340	0.096	LT 0.050	2.140	LT 0.051
08/23/89	LT 1.340	0.053	LT 0.050	2.040	LT 0.051
08/30/89	LT 1.340	0.062	LT 0.050	2.030	LT 0.051
09/06/89	LT 1.340	LT 0.050	LT 0.050	1.700	LT 0.051
09/13/89	LT 1.340	LT 0.050	LT 0.050	2.150	LT 0.051
09/20/89	LT 1.340	LT 0.050	LT 0.050	2.030	LT 0.051
09/27/89	LT 1.340	LT 0.050	LT 0.050	2.370	LT 0.051

LT = LESS THAN The Following Concentration

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

ug/l = MICROGRAM PER LITER

mg/l = MILLIGRAM PER LITER

WESTFAIR SORBENT TREATMENT PLANT - EFFLUENT FOR FY 89

SAMPLE DATE	CAT ug/l	PPDDE ug/l	PCDDE ug/l	PETHM ug/l	SC6 mg/l	SUPOMA ug/l	TCLER ug/l	TRCLE ug/l	XYLEN ug/l
10/06/88	LT 2.380	LT 0.560
10/13/88	LT 2.380	LT 0.560
10/20/88	LT 2.380
10/27/88	LT 2.380	LT 0.560
11/03/88	LT 2.380	LT 0.560
11/10/88	LT 2.380	LT 0.560
11/17/88	LT 2.380	LT 0.560
11/24/88
12/01/88	LT 2.380	LT 0.560
12/08/88	LT 2.380	LT 0.560
12/15/88	LT 2.380	LT 0.560
12/22/88	LT 2.380	LT 0.560
12/29/88
01/04/89	LT 2.380	LT 0.560
01/11/89	LT 2.380	LT 0.560
01/18/89	LT 2.380	LT 0.054	LT 0.049	LT 0.647	130	LT 0.769	LT 0.560	LT 1.360
01/25/89	LT 2.380	LT 0.560
02/01/89	LT 2.380	LT 0.560
02/08/89	LT 2.380	LT 0.560
02/15/89	LT 2.380	LT 0.560
02/22/89	LT 2.380	LT 0.560
03/01/89	LT 0.560
03/08/89	LT 2.380	LT 0.560
03/15/89	LT 2.380	LT 0.560
03/22/89	LT 2.380	LT 0.560
03/29/89	LT 2.380	LT 0.560
04/05/89	LT 2.380	LT 0.560
04/12/89	LT 2.380	LT 0.560
04/19/89	LT 2.380	LT 0.560
04/26/89	LT 2.380	LT 0.560
05/03/89	LT 2.380	LT 0.560
05/10/89	LT 2.380	LT 0.560
05/17/89	LT 2.380	LT 0.560
05/24/89	LT 2.380
05/31/89	LT 2.380	LT 0.560
06/07/89
06/14/89	LT 2.380	LT 0.560
06/21/89	LT 2.380	LT 0.054	LT 0.049	1.660	140	1.970	LT 0.560	LT 1.360
06/28/89	LT 2.380	LT 0.560
07/05/89	LT 2.380	LT 0.560
07/12/89	LT 2.380	LT 0.560
07/19/89	LT 2.380	LT 0.560
07/26/89	LT 2.380	LT 0.560
08/02/89	LT 2.380	LT 0.560
08/09/89	LT 2.380	LT 0.560
08/16/89	LT 2.380	LT 0.560
08/23/89	LT 2.380	LT 0.560
08/30/89	LT 2.380	LT 0.560
09/06/89	LT 2.380	LT 0.560
09/13/89	LT 2.380	LT 0.560
09/20/89	LT 2.380	LT 0.560
09/27/89	LT 2.380	LT 0.560

LT = LESS THAN the following concentration

ug/l = MICROGRAM PER LITER

.... INDICATES THAT ANALYSIS WAS NOT PERFORMED

mg/l = MILLIGRAM PER LITER

D.P.A.

09/18/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY SYSTEM

SITE: PWININ

ANALYTE	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	CERTIFIED REPORT		MEAN	LOW VALUE	HIGH VALUE
					LIMIT (LT)	UGL			
111TCE	2	0	0%	N8	0.76	UGL	LT CRL	LT CRL	LT CRL
112TCE	2	0	0%	N8	0.78	UGL	LT CRL	LT CRL	LT CRL
11DCE	2	0	0%	N8	1.70	UGL	LT CRL	LT CRL	LT CRL
11DCLE	2	0	0%	N8	0.73	UGL	LT CRL	LT CRL	LT CRL
12DCE	2	0	0%	N8	0.76	UGL	LT CRL	LT CRL	LT CRL
12DCLE	2	0	0%	N8	1.10	UGL	LT CRL	LT CRL	LT CRL
13DMB	2	0	0%	AV8	1.32	UGL	LT CRL	LT CRL	LT CRL
ALDRN	47	2	4%	KK8	0.05	UGL	LT CRL	LT CRL	0.11
AS	2	0	0%	AX8	2.35	UGL	LT CRL	LT CRL	LT CRL
ATZ	1	0	0%	UH11	4.03	UGL	LT CRL	LT CRL	LT CRL
BCHPD	1	0	0%	P8	5.90	UGL	LT CRL	LT CRL	LT CRL
BTZ	2	0	0%	AAA8	5.00	UGL	LT CRL	LT CRL	LT CRL
C6H6	2	0	0%	AV8	1.05	UGL	LT CRL	LT CRL	LT CRL
CCL4	2	0	0%	N8	0.99	UGL	LT CRL	LT CRL	LT CRL
CH2CL2	2	0	0%	N8	7.40	UGL	LT CRL	LT CRL	LT CRL
CHCL3	2	2	100%	N8		UGL	34.73	21.65	47.80
CL	49	49	100%	HH8A, TT09		MGL	264.97	190.00	360.00
CL6CP	2	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CRL
CLC6H5	2	0	0%	N8	0.82	UGL	LT CRL	LT CRL	LT CRL
CLDAN	2	0	0%	KK8	0.10	UGL	LT CRL	LT CRL	LT CRL
CPMS	49	0	0%	AAA8	5.69	UGL	LT CRL	LT CRL	LT CRL
CPMSO	49	0	0%	AAA8	11.5	UGL	LT CRL	LT CRL	LT CRL
CPMSO2	49	0	0%	AAA8	7.46	UGL	LT CRL	LT CRL	LT CRL
DBCP	48	0	0%	AY8	0.20	UGL	LT CRL	LT CRL	LT CRL
DCPD	46	0	0%	P8	5.00	UGL	LT CRL	LT CRL	LT CRL
DDVP	1	0	0%	UH11	0.38	UGL	LT CRL	LT CRL	LT CRL
DIMP	47	47	100%	AW8A, ATS		UGL	3.32	1.97	5.59
DITH	49	0	0%	AAA8	1.34	UGL	LT CRL	LT CRL	LT CRL
DLDRN	48	46	96%	KK8	0.05	UGL	0.39	LT CRL	0.65
DMDS	2	0	0%	AAA8	0.55	UGL	LT CRL	LT CRL	LT CRL
DMMP	1	0	0%	ATS	0.19	UGL	LT CRL	LT CRL	LT CRL
ENDRN	48	1	2%	KK8	0.05	UGL	LT CRL	LT CRL	0.05
ETC6H5	2	0	0%	AV8	1.37	UGL	LT CRL	LT CRL	LT CRL
F	49	49	100%	HH8A, TT09		MGL	2.13	1.36	2.83
ISODR	48	5	10%	KK8	0.05	UGL	LT CRL	LT CRL	0.09
MEC6H5	2	0	0%	AV8	1.47	UGL	LT CRL	LT CRL	LT CRL
MIBK	1	0	0%	P8	4.90	UGL	LT CRL	LT CRL	LT CRL
MLTHN	1	0	0%	UH11	0.37	UGL	LT CRL	LT CRL	LT CRL
OXAT	49	0	0%	AAA8	2.38	UGL	LT CRL	LT CRL	LT CRL
PPDDZ	2	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CRL
PPDGT	2	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CRL
PRTHN	2	1	50%	UH11	0.65	UGL	LT CRL	LT CRL	1.76
SO4	2	2	100%	HH8A		MGL	135.00	130.00	140.00
SUPONA	1	0	0%	UH11	0.79	UGL	LT CRL	LT CRL	LT CRL
TCLEE	2	0	0%	N8	0.75	UGL	LT CRL	LT CRL	LT CRL
TRCLE	49	1	2%	N8	0.56	UGL	LT CRL	LT CRL	0.67
XYLEN	2	0	0%	AV8	1.36	UGL	LT CRL	LT CRL	LT CRL
ZN	2	1	50%	GG8, SS12	18.0	UGL	LT CRL	LT CRL	22.95

D.P.A.

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY SYSTEM

09/18/90

SITE: PWEPEP

ANALYTE	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	CERTIFIED			LOW VALUE	HIGH VALUE
					REPORT LIMIT (LT)	UOM	MEAN		
111TCE	2	0	0%	N8	0.76	UGL	LT CRL	LT CRL	LT CF
112TCE	2	0	0%	N8	0.78	UGL	LT CRL	LT CRL	LT CRL
11DCX	2	0	0%	N8	1.70	UGL	LT CRL	LT CRL	LT CRL
11DCLE	2	0	0%	N8	0.73	UGL	LT CRL	LT CRL	LT CF
12DCX	2	0	0%	N8	0.76	UGL	LT CRL	LT CRL	LT CF
12DCLE	2	0	0%	N8	1.10	UGL	LT CRL	LT CRL	LT CRL
13DMB	2	0	0%	AV8	1.32	UGL	LT CRL	LT CRL	LT CF
ALDRN	47	3	6%	KK8	0.05	UGL	LT CRL	LT CRL	0.1
AS	2	0	0%	AX8	2.35	UGL	LT CRL	LT CRL	LT CRL
ATZ	1	0	0%	UH11	4.03	UGL	LT CRL	LT CRL	LT CRL
BCHPD	1	0	0%	PS	5.90	UGL	LT CRL	LT CRL	LT CF
BTZ	2	0	0%	AAA8	5.00	UGL	LT CRL	LT CRL	LT CF
C6H6	2	0	0%	AV8	1.05	UGL	LT CRL	LT CRL	LT CRL
CCL4	2	0	0%	N8	0.99	UGL	LT CRL	LT CRL	LT CF
CH2CL2	2	0	0%	N8	7.40	UGL	LT CRL	LT CRL	LT CF
CHCL3	2	2	100%	N8		UGL	21.60	19.70	23.5
CL	49	49	100%	HH8A, TT09		MGL	261.53	200.00	350.00
CL6CP	2	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CF
CLC6H5	2	0	0%	N8	0.82	UGL	LT CRL	LT CRL	LT CF
CLDAN	2	0	0%	KK8	0.10	UGL	LT CRL	LT CRL	LT CRL
CPMS	48	0	0%	AAA8	5.69	UGL	LT CRL	LT CRL	LT CRL
CPMSO	48	0	0%	AAA8	11.5	UGL	LT CRL	LT CRL	LT CF
CPMSO2	48	0	0%	AAA8	7.46	UGL	LT CRL	LT CRL	LT CF
DBCP	48	0	0%	AY8	0.20	UGL	LT CRL	LT CRL	LT CRL
DCPD	46	0	0%	PS	5.00	UGL	LT CRL	LT CRL	LT CF
DDVP	1	0	0%	UH11	0.38	UGL	LT CRL	LT CRL	LT CF
DIMP	47	47	100%	AW8A, AT8		UGL	4.17	2.19	5.9
DITH	48	0	0%	AAA8	1.34	UGL	LT CRL	LT CRL	LT CRL
DLDRN	48	4	8%	KK8	0.05	UGL	LT CRL	LT CRL	0.1
DMDS	2	0	0%	AAA8	0.55	UGL	LT CRL	LT CRL	LT CF
DMMP	1	0	0%	AT8	0.19	UGL	LT CRL	LT CRL	LT CRL
ENDRN	48	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CF
ETC6H5	2	0	0%	AV8	1.37	UGL	LT CRL	LT CRL	LT CF
F	49	49	100%	HH8A, TT09		MGL	2.13	1.39	2.7
ISODR	48	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CRL
MEC6H5	2	0	0%	AV8	1.47	UGL	LT CRL	LT CRL	LT CF
MIBK	1	0	0%	PS	4.90	UGL	LT CRL	LT CRL	LT CF
MLTHN	1	0	0%	UH11	0.37	UGL	LT CRL	LT CRL	LT CRL
OXAT	48	0	0%	AAA8	2.38	UGL	LT CRL	LT CRL	LT CRL
PPDOE	2	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CF
PPDDT	2	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CF
PRTHN	2	1	50%	UH11	0.65	UGL	LT CRL	LT CRL	1.66
SO4	2	2	100%	HH8A		MGL	135.00	130.00	140.0
SUPONA	1	0	0%	UH11	0.79	UGL	LT CRL	LT CRL	LT CF
TCLSE	2	1	50%	N8	0.75	UGL	LT CRL	LT CRL	1.9
TRCLE	47	0	0%	N8	0.56	UGL	LT CRL	LT CRL	LT CRL
XYLEN	2	0	0%	AV8	1.36	UGL	LT CRL	LT CRL	LT CF
ZN	2	0	0%	GG8, SS12	22.0, 18.0	UGL	LT CRL	LT CRL	LT CF

D.P.A.

03/09/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY SYSTEM

SITE: PWININ

ANALYZE	TOT SAMP	>CRL	CRL	MTH NO.	CERTIFIED			LOW VALUE	HIGH VALUE
					REPORT LIMIT (LT)	UQM	MEAN		
MLTHN	2	0	0%	UH11	0.37	UGL	LT CRL	LT CRL	LT CRL
NA	4	4	100%	GG8, SS12		UGL	182,500.00	999.00	190,000
NIT	2	2	100%	LL8		UGL	6,650.00	999.00	6,900
OXAT	54	0	0%	AAA8	2.38	UGL	LT CRL	LT CRL	LT CRL
PB	6	0	0%	GG8, SS12	74.0, 43.4	UGL	LT CRL	LT CRL	LT CRL
PPDDE	4	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CRL
PPDDT	4	0	0%	KK8	0.05	UGL	LT CRL	LT CRL	LT CRL
PRTHN	4	2	50%	UH11	0.65	UGL	LT CRL	LT CRL	1.77
SO4	4	4	100%	HH8A		MGL	135.00	130.00	150.00
SUPONA	2	0	0%	UH11	0.79	UGL	LT CRL	LT CRL	LT CRL
TCLEE	4	0	0%	N8	0.75	UGL	LT CRL	LT CRL	LT CRL
TRCLE	54	1	2%	N8	0.56	UGL	LT CRL	LT CRL	0.88
XYLEN	4	0	0%	AV8	1.36	UGL	LT CRL	LT CRL	LT CRL
ZN	4	1	25%	GG8, SS12	22.0, 18.0	UGL	LT CRL	LT CRL	23.90

D.P.A.

03/09/90

DATACHM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY SYSTEM

SITE: PWEFEP

ANALYTE	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	CERTIFIED			LOW VALUE	HIGH VALUE
					REPORT LIMIT (LT)	UCM	MEAN		
MLTHN	1	0	0%	UH11	0.37	UGL		LT CRL	LT CRL
NA	2	2	100%	GG8, SS12		UGL	185,000.00	999.00	190,000
NIT	1	1	100%	LL8		UGL	6,500.00	999.00	6,500
OXAT	50	0	0%	AAAS	2.38	UGL		LT CRL	LT CRL
PB	3	0	0%	GG8, SS12	74.0, 43.4	UGL		LT CRL	LT CRL
PPDDE	2	0	0%	KK8	0.05	UGL		LT CRL	LT CRL
PPDDT	2	0	0%	KK8	0.05	UGL		LT CRL	LT CRL
PRTHN	2	1	50%	UH11	0.65	UGL		LT CRL	LT CRL
SO4	2	2	100%	HH8A		MGI.	135.00	130.00	140.00
SUPONA	1	0	0%	UH11	0.79	UGL		LT CRL	LT CRL
TCLZE	2	1	50%	N8	0.75	UGL		LT CRL	LT CRL
TRCLE	49	0	0%	N8	0.56	UGL		LT CRL	LT CRL
XYLEN	2	0	0%	AV8	1.36	UGL		LT CRL	LT CRL
ZN	2	0	0%	GG8, SS12	22.0, 18.0	UGL		LT CRL	LT CRL

ROCKY MOUNTAIN ARSENAL
NORTHWEST BOUNDARY CONTAINMENT/TREATMENT SYSTEM
GC/MS ANALYTICAL DATA

LABORATORY: DATACHEM
SAMPLE DATE: 06/21/89
UNIT OF MEASURE: UGL

ANALYTE	CODE	PWINTN	PWFPER
2,3,6-TRICHLOROPHENOL	236TCP	LT 1.70	LT 1.70
2,4,5-TRICHLOROPHENOL	245TCP	LT 2.80	LT 2.80
2,4,6-TRICHLOROPHENOL	246TCP	LT 3.60	LT 3.60
2,4-DICHLOROPHENOL	240CLP	LT 8.40	LT 8.40
2,4-DIMETHYLPHENOL	240MPN	LT 4.40	LT 4.40
2,4-DINITROPHENOL	240NP	LT 176.00	LT 176.00
2-CHLOROPHENOL	2CLP	LT 2.80	LT 2.80
2-METHYLPHENOL	2MP	LT 3.60	LT 3.60
2-NITROPHENOL	2NP	LT 8.20	LT 8.20
3-METHYL-4-CHLOROPHENOL	4CL3C	LT 8.50	LT 8.50
4-METHYLPHENOL	4MP	LT 2.80	LT 2.80
4-NITROPHENOL	4NP	LT 96.00	LT 96.00
ALDRIN	ALDRN	LT 13.00	LT 13.00
ATRAZINE	ATZ	LT 5.90	LT 5.90
HEXACHLOROCYCLOPENTADIENE (HCCPO)	CL6CP	LT 54.00	LT 54.00
CHLORDANE	CLDAN	LT 37.00	LT 37.00
P-CHLOROPHENYLMETHYL SULFIDE	CPMS	LT 10.00	LT 10.00
P-CHLOROPHENYLMETHYL SULFOXIDE	CPMSO	LT 15.00	LT 15.00
P-CHLOROPHENYLMETHYL SULFONE	CPMSO2	LT 5.30	LT 5.30
DIBROMODICLOROPROPANE	DCBP	LT 12.00	LT 12.00
DICYCLOPENTADIENE	DCPD	LT 5.50	LT 5.50
VAPONA	DOVP	LT 8.50	LT 8.50
DIISOPROPYL METHYLPHOSPHONATE	DIMP	LT 21.00	LT 21.00
DITNTIANE	DITH	LT 3.30	LT 3.30
DTEDRIN	DLDRN	LT 26.00	LT 26.00
DIMETHYLMETHYLPHOSPHATE	DMMP	LT 130.00	LT 130.00
ENORIN	ENDRN	LT 18.00	LT 18.00
ISOCRIN	ISODR	LT 7.80	LT 7.80
HALATHION	HLTHN	LT 21.00	LT 21.00
1,4-OXATHIANE	OXAT	LT 27.00	LT 27.00
PENTACHLOROPHENOL	PCP	LT 9.10	LT 9.10
PHENOL	PHENOL	LT 2.20	LT 2.20
2,2-BIS(PARA-CHLOROPHENYL)-1,1-DICHLOROETHENE	PPDE	LT 14.00	LT 14.00
2,2-BIS(PARA-CHLOROPHENYL)1,1,1-TRICHLOROETHANE	PPDOT	LT 18.00	LT 18.00
PARATHION	PRTHN	LT 37.00	LT 37.00
SUPONA	SUPONA	LT 19.00	LT 19.00

APPENDIX C
DEWATERING WELL DATA

C1

D.P.A.

03/20/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: ALDRN
CERTIFIED REPORTING LIMIT (LT): 0.05

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
2	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.45
3	3	2	67%	KK8	UGL	LT CRL	LT CRL	0.08
4	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.06
5	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.08
6	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
8	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
9	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
10	4	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
11	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.06
12	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.09
13	4	1	25%	KK8	UGL	LT CRL	LT CRL	0.08
14	4	2	50%	KK8	UGL	LT CRL	LT CRL	0.23
15	4	1	25%	KK8	UGL	LT CRL	LT CRL	0.12

D.P.A.

03/20/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY Dewatering Wells

ANALYTE: CHLORIDE
CERTIFIED REPORTING LIMIT (LT): 0.72, 0.278

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	3	100%	HH8A	MCL	166.67	160.00	170.00
2	3	3	100%	HH8A	MCL	183.33	180.00	190.00
3	3	3	100%	HH8A	MCL	263.33	210.00	330.00
4	3	3	100%	HH8A, TT09	MCL	230.00	190.00	260.00
5	3	3	100%	HH8A, TT09	MCL	243.33	210.00	300.00
6	3	3	100%	HH8A, TT09	MCL	280.00	250.00	300.00
7	3	3	100%	HH8A, TTC9	MCL	286.67	270.00	310.00
8	3	3	100%	HH8A, TT09	MCL	306.67	290.00	340.00
9	3	3	100%	HH8A, TT09	MCL	263.33	230.00	290.00
10	3	3	100%	HH8A, TT09	MCL	276.67	250.00	300.00
11	4	4	100%	HH8A, TT09	MCL	367.50	300.00	440.00
12	4	4	100%	HH8A, TT09	MCL	322.50	280.00	390.00
13	4	4	100%	HH8A, TTC9	MCL	417.50	290.00	680.00
14	5	5	100%	HH8A, TT09	MCL	566.00	430.00	780.00
15	3	3	100%	HH8A	MCL	586.67	520.00	690.00

D.P.A.

03/20/90

DATA CHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: DSCP
CERTIFIED REPORTING LIMIT (LT): 0.195

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
2	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
3	2	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
4	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
8	4	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
9	4	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
10	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
11	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
12	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
13	4	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
14	3	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL
15	4	0	0%	AY8	UGL	LT CRL	LT CRL	LT CRL

D.P.A.

DATACHEM

03/20/90

FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: COMB. ORGANO-SULFUR
CERTIFIED REPORTING LIMIT (LT): 24.65

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
2	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
3	1	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
4	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
8	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
9	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
10	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
11	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
12	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
13	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
14	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
15	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL

D.P.A.

DATAChem

FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: DCPD
CERTIFIED REPORTING LIMIT (LT): 5

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
2	3	1	33%	P8	UGL	LT CRL	LT CRL	9.82
3	3	2	67%	P8	UGL	LT CRL	LT CRL	14.60
4	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
7	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
8	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
9	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
10	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
11	4	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
12	4	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
13	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
14	4	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL
15	3	0	0%	P8	UGL	LT CRL	LT CRL	LT CRL

D.P.A.

03/30/90

DATACHIN
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: DIMP
CERTIFIED REPORTING LIMIT (LT): 0.65

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	1	33%	AW8A	UGL	LT CRL	LT CRL	1.35
2	3	1	33%	AW8A	UGL	LT CRL	LT CRL	1.70
3	3	3	100%	AW8A	UGL	19.98	1.35	57.20
4	3	3	100%	AW8A	UGL	1.73	1.35	2.34
5	3	3	100%	AW8A	UGL	2.00	1.23	3.04
6	3	3	100%	AW8A	UGL	3.93	3.53	4.26
7	4	4	100%	AW8A	UGL	3.81	3.36	4.39
8	4	4	100%	AW8A	UGL	4.89	4.47	5.34
9	4	4	100%	AW8A	UGL	4.57	4.20	5.11
10	4	4	100%	AW8A	UGL	4.54	4.01	4.96
11	3	3	100%	AW8A	UGL	6.83	5.19	8.07
12	3	3	100%	AW8A	UGL	4.55	3.65	5.43
13	4	4	100%	AW8A	UGL	9.62	4.58	15.10
14	3	3	100%	AW8A	UGL	9.91	7.96	12.60
15	4	4	100%	AW8A	UGL	178.82	3.85	690.00

D.P.A.

DATACHEM

FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: DITH
CERTIFIED REPORTING LIMIT (LT): 1.34

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
2	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
3	1	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
4	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
8	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
9	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
10	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
11	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
12	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
13	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
14	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
15	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL

D.P.A.

DATACHEM

03/20/90

PY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: DLDRN
CERTIFIED REPORTING LIMIT (LT): 0.05

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	3	100%	KK8	UGL	0.44	0.24	0.68
2	3	3	100%	KK8	UGL	0.65	0.41	1.10
3	3	3	100%	KK8	UGL	1.00	0.81	1.10
4	3	3	100%	KK8	UGL	0.65	0.60	0.73
5	3	3	100%	KK8	UGL	0.59	0.52	0.65
6	5	1	33%	KK8	UGL	LT CRL	LT CRL	0.24
7	4	4	100%	KK8	UGL	0.43	0.16	0.56
8	3	3	100%	KK8	UGL	0.27	0.23	0.31
9	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
10	4	4	100%	KK8	UGL	0.18	0.05	0.49
11	3	3	100%	KK8	UGL	0.52	0.35	0.63
12	3	3	100%	KK8	UGL	0.29	0.24	0.33
13	4	4	100%	KK8	UGL	2.22	0.47	7.00
14	4	4	100%	KK8	UGL	0.68	0.64	0.76
15	4	4	100%	KK8	UGL	1.56	0.51	4.40

D.P.A.

03/20/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: ENDRN
CERTIFIED REPORTING LIMIT (LT): 0.05

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
2	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.47
3	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
4	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
8	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
9	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
10	4	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
11	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
12	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
13	4	1	25%	KK8	UGL	LT CRL	LT CRL	0.07
14	4	4	100%	KK8	UGL	0.12	0.08	0.19
15	4	3	75%	KK8	UGL	0.19	0.07	0.09

D.P.A.

03/20/90

DATACHM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: FLUORIDE
CERTIFIED REPORTING LIMIT (LT): 0.432, 0.153

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	3	100%	HH8A	MGL	1.42	1.39	1.46
2	3	3	100%	HH8A	MGL	1.60	1.54	1.71
3	3	3	100%	HH8A	MGL	1.78	1.55	1.95
4	3	3	100%	HH8A, TT09	MGL	1.76	1.48	2.01
5	3	3	100%	HH8A, TT09	MGL	1.83	1.65	2.11
6	3	3	100%	HH8A, TT09	MGL	2.24	2.03	2.45
7	3	3	100%	HH8A, TT09	MGL	2.18	1.99	2.48
8	3	3	100%	HH8A, TT09	MGL	3.10	2.00	4.86
9	3	3	100%	HH8A, TT09	MGL	1.82	1.45	2.30
10	3	3	100%	HH8A, TT09	MGL	2.05	1.72	2.26
11	4	4	100%	HH8A, TT09	MGL	2.42	1.80	3.13
12	4	4	100%	HH8A, TT09	MGL	2.47	1.89	2.81
13	4	4	100%	HH8A, TT09	MGL	3.13	1.97	4.64
14	5	5	100%	HH8A, TT09	MGL	3.58	3.00	4.30
15	3	3	100%	HH8A	MGL	3.99	3.59	4.77

D.P.A.

DATACHEM

03/20/90

FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: ISODR
CERTIFIED REPORTING LIMIT (LT): 0.051

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
2	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
3	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.08
4	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
8	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.07
9	3	0	0%	KK8	UGL	LT CRL	LT CRL	LT CRL
10	4	1	25%	KK8	UGL	LT CRL	LT CRL	0.62
11	3	2	67%	KK8	UGL	LT CRL	LT CRL	0.18
12	3	1	33%	KK8	UGL	LT CRL	LT CRL	0.09
13	4	1	25%	KK8	UGL	LT CRL	LT CRL	0.07
14	4	2	50%	KK8	UGL	LT CRL	LT CRL	0.28
15	4	2	50%	KK8	UGL	LT CRL	LT CRL	0.35

D.P.A.

03/20/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: OXAT
CERTIFIED REPORTING LIMIT (LT): 2.38

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
2	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
3	1	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
4	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
8	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
9	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
10	3	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
11	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
12	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
13	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
14	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL
15	4	0	0%	AAA8	UGL	LT CRL	LT CRL	LT CRL

D.P.A.

03/20/90

DATACHEM
FY 89 STATISTICAL SUMMARY
NORTHWEST BOUNDARY DEWATERING WELLS

ANALYTE: TRCLE
CERTIFIED REPORTING LIMIT (LT): 0.56

WELL NO.	TOT SAMP	SAMP >CRL	% > CRL	MTH NO.	UOM	MEAN	LOW VALUE	HIGH VALUE
1	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
2	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
3	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
4	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
5	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
6	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
7	4	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
8	4	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
9	4	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
10	4	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
11	3	1	33%	N8	UGL	LT CRL	LT CRL	0.67
12	3	0	0%	N8	UGL	LT CRL	LT CRL	LT CRL
13	4	1	25%	N8	UGL	LT CRL	LT CRL	1.27
14	4	4	100%	N8	UGL	1.09	0.74	1.44
15	4	1	25%	N8	UGL	LT CRL	LT CRL	1.30

APPENDIX D
NORTHWEST BOUNDARY SYSTEM DOWNTIME

D1

1st QUARTER REPORT

FISCAL YEAR 19989

**NORTHWEST BOUNDARY PILOT
DOWNTIME SUMMARY BY ADSORBER**

ADSORBER	TIME LOST (HRS)			
-----	OCT 88	NOV 88	DEC 88	1st QTR FY 1989
-----	-----	-----	-----	-----
V101	0.00	0.00	0.00	0.00
V102	0.00	0.00	25.75	25.75
V103	0.00	0.00	0.00	0.00
ALL (the the same time)	5.50	0.00	0.00	5.50

NORTHWEST BOUNDARY

1st QUARTER FISCAL YEAR 90

QUARTERLY DOWNTIME SUMMARY

DATE	ADS/TIME LOSS	JUSTIFICATION
12 OCT 88	ALL/.25 hrs	Plant power off - check transformer
21 OCT 88	ALL/5.25 hrs	Water leaks - main line and filter pod

NO LOSS OF PLANT OPERATIONS DUE TO DOWNTIME WAS REPORTED FOR THE MONTH OF NOVEMBER 1988.

01 DEC 88	V102/18.75	Install R.C. Line Cleanout
02 DEC 88	V102/7.00	Install R.C. Line Cleanout

**NORTHWEST BOUNDARY SYSTEM
2nd QUARTER REPORT
FISCAL YEAR 1989**

AVERAGE FLOWS:

Area of Consideration	Time of Period	1 Jan - 1 Feb 89	1 Feb - 30 Nov 89	1 Mar - 31 Dec 89	1 Jan - 1 Apr 89
Recharge - Flow Wells (RC)	- Total	545.04 gpm 24,330,500 gal	558.37 gpm 22,513,400 gal	591.36 gpm 26,398,200 gal	564.81 gpm 73,242,100 gal
Dewatering - Flow Wells (DW)	- Total	482.44 gpm 21,535,900 gal	527.68 gpm 21,276,000 gal	504.23 gpm 22,508,900 gal	504.78 gpm 65,320,800 gal
Plant - Flow (All Ads)	- Total	585.49 gpm 26,136,000 gal	618.62 gpm 24,943,000 gal	650.45 gpm 29,036,000 gal	285.23 gpm 80,115,000 gal
Ads 101 - Flow - Total		0.00 gpm 0 gal	193.08 gpm 8,027,000 gal	361.16 gpm 16,122,000 gal	186.75 gpm 24,149,000 gpm
Ads 102 - Flow - Total		351.12 gpm 15,674,000 gal	141.65 gpm 5,711,000 gal	0.00 gpm 0 gal	164.26 gpm 21,385,000 gal
Ads 103 - Flow - Total		234.37 gpm 10,462,000 gal	277.89 gpm 11,203,000 gal	289.29 gpm 12,914,000 gal	267.18 gpm 34,581,000 gal

NORTHWEST BOUNDARY SYSTEM
PLANT DOWNTIME SUMMARY
2nd QUARTER 1989

PLANT SUMMARY

PERIOD: 1 Jan - 1 Apr 89

DATE	ADS/LOSS TIME	JUSTIFICATION
10 Feb 89	102/4.17 hrs.	Plugged Line
10 Feb 89	103/4.42 hrs.	Plugged Line
14 Feb 89	102/11.00 hrs.	Plugged Line
14 Feb 89	103/5.67 hrs.	Plugged Line
15 Feb 89	101/13.42 hrs.	Restart/Opns.
15 Feb 89	102/5.58 hrs.	Stop/Opns.
15 Feb 89	103/13.42 hrs.	Plugged Filter

NORTHWEST BOUNDARY SYSTEM
PLANT DOWNTIME SUMMARY
3rd QUARTER 1989

PERIOD 1 Apr - 1 Jul 89

NOTE: There was no downtime for the entire 3rd quarter in Fiscal Year 1989.

**NORTHWEST BOUNDARY SYSTEM
3rd QUARTER REPORT
FISCAL YEAR 1989**

AVERAGE FLOWS:

Area of Consideration	Time of Period	1 Apr - 1 May 89	1 May - 30 Jun 89	1 Jun - 31 Jul 89	1 Apr - 1 Jul 89
Recharge - Flow Wells (RC)	- Total	618.11 gpm	605.49 gpm	593.94 gpm	605.85 gpm
		26,702,100 gal	27,029,200 gal	25,658,000 gal	29,389,300 gal
Dewatering - Flow Wells (DW)	- Total	675.25 gpm	598.05 gpm	589.49 gpm	620.93 gpm
		29,170,600 gal	26,969,900 gal	25,466,100 gal	31,333,600 gal
Plant - Flow (All Ads)	- Total	684.96 gpm	667.04 gpm	658.27 gpm	670.09 gpm
		29,590,000 gal	29,777,000 gal	28,437,000 gal	37,804,000 gal
Ads 101 - Flow	- Total	336.80 gpm	339.14 gpm	658.27 gpm	670.09 gpm
		14,550,000 gal	15,139,000 gal	14,455,000 gal	44,144,000 gpm
Ads 102 - Flow	- Total	0.00 gpm	0.00 gpm	0.00 gpm	0.00 gpm
		0 gal	0 gal	0 gal	0 gal
Ads 103 - Flow	- Total	348.15 gpm	327.90 gpm	323.66 gpm	333.24 gpm
		15,040,000 gal	14,638,000 gal	13,982,000 gal	43,660,000 gal

NORTHWEST BOUNDARY SYSTEM
4th QUARTER REPORT
FISCAL YEAR 1989

AVERAGE FLOWS:

Area of Consideration	Time of Period	1 Jul - 1 Aug 89	1 Aug - 30 Sep 89	1 Sep - 31 Oct 89	1 Jul - 1 Oct 89
Recharge - Flow Wells		562.83 gpm	523.07 gpm	530.19 gpm	538.69 gpm
(RC) - Total		25,124,800 gal	23,349,700 gal	22,903,800 gal	71,378,300 gal
Dewatering - Flow Wells		588.85 gpm	528.45 gpm	551.29 gpm	556.20 gpm
(DW) - Total		29,947,100 gal	23,589,800 gal	23,815,600 gal	72,352,500 gal
Plant - Flow (All Ads)		622.19 gpm	582.27 gpm	611.27 gpm	605.24 gpm
- Total		27,775,000 gal	25,992,000 gal	24,406,900 gal	78,173,900 gal
Ads 101 - Flow		348.16 gpm	348.15 gpm	347.63 gpm	348.08 gpm
- Total		15,555,000 gal	15,541,000 gal	15,071,500 gal	46,167,500 gal
Ads 102 - Flow		0.00 gpm	45.86 gpm*	248.80 gpm	98.22 gpm
- Total		0 gal	2,047,000 gal	10,748,000 gal	12,795,000 gal
Ads 103 - Flow		273.73 gpm	188.26 gpm	14.84 gpm^	158.94 gpm
- Total		12,220,000 gal	8,404,000 gal	614,300 gal	21,238,300 gal

Note: * Start up adsorber V-102. + Shutting down adsorber V-103. ^ Adsorber V-103 run while V-102 has a new meter installed.